



Controller Models

- EVCB14NIT0S** (0 TRIACS / pressure independent)
- EVCB14NIT2S** (2 TRIACS / pressure independent)
- EVCB14NIT4S** (4 TRIACS / pressure independent)
- EVCB14NDT4S** (4 TRIACS / pressure dependent)
- EVCB14NIT0SF** (0 TRIACS / independent / feedback)
- EVCB14NIT4SF** (4 TRIACS / independent / feedback)

TRL Series Digital Room Sensor

- TRL24** (With temperature sensor)
- TRLH24** (With temperature and humidity sensor)
- TRLG24** (With temperature and CO₂ sensor)
- TRLGH24** (With temperature, CO₂ and humidity sensors)

TDU Series Digital Room Sensor

- TDU00** (Vertical Grey LCD, white enclosure)
- TDU30** (Vertical Black LCD, black enclosure)
- TDU60** (Vertical Black LCD, white enclosure)
- TDU10** (Horizontal Grey LCD, white enclosure)
- TDU40** (Horizontal Black LCD, black enclosure)
- TDU70** (Horizontal Black LCD, white enclosure)

Description

The EVCB Series is a combination controller and digital room sensor with support for networked communications via the BACnet MS/TP or Modbus protocol. The EVCB Series controller is compatible with both TRL24 and TDU series digital room sensors. The Networkable VAV Controller is designed for simple and accurate control of any variable air volume box in a number of zone control configurations. Its field configurable algorithms enable versatile implementation of required control sequences.

Features

- Field configured VAV algorithms, inputs and outputs
- Built-in actuator, 70 lb-in
- On board differential pressure sensor (select models)
- Select direction on analog outputs
- Simple air balancing and commissioning via digital room sensor
- Automatically sets operation mode to pressure dependent or independent based on the presence of air flow
- Configurable PI (Proportional-Integral) function
- Independent, configurable proportional control band and dead band per ramp
- Selectable internal or external temperature sensor (10KΩ)
- Activate output with CO₂ sensor from TRL/TDU or external sensor input
- Changeover by contact or external temperature sensor
- Internal and external temperature sensor calibration
- Optional potentiometer feedback for increased precision of actuator position
- Freeze protection
- Removable, raising clamp, non-strip terminals

Operational Features

- Backlit LCD with simple icon and text driven menus
- Select digital room sensor's default display
- Network service port via on-board mini USB connector
- Manual night setback or no occupancy override
- Multi level lockable access menu and setpoint
- Selectable Fahrenheit or Celsius scale
- 3-wire connection to controller and 4 push buttons



EVCB Series



TRL24 Series



TDU00 / TDU30 / TDU60 Series



TDU10 / TDU40 / TDU70 Series

Applications

- Single duct, cooling only
- Single duct cooling and/or heating
- Up to 4 stage reheat and/or cool
- Up to 4 On/Off heat and/or cool
- Up to 4 time proportioned (TPM) heat or reheat
- Up to 2 analog (0-10Vdc) reheat and/or cool
- Up to 2 floating heat and/or cool
- Pressure dependent or pressure independent
- With or without auto changeover
- Supply/exhaust (requires an additional EVC)

Network Communication

- BACnet MS/TP or Modbus communication port
- Select MAC address via DIP switch or via network
- Automatic baud rate detection

BACnet MS/TP®

- Automatic device instance configuration
- Copy & broadcast configuration via digital room sensor menu or via BACnet to other controllers
- BACnet scheduler
- Firmware upgradeable via BACnet
- Support COV (change of value)

Modbus

- Modbus @ 9600, 19200, 38400 or 57600 bps
- RTU Slave, 8 bits (configurable parity and stop bits)
- Connects to any Modbus master




Controller Specifications

Description	EVCB Series
Torque	70 in.lb. [8 Nm] at rated voltage
Power consumption	10 VA max
Running time through 90°	90 seconds
Power supply	22 to 26 Vac 50/60 Hz
Inputs	2 Universal inputs (Thermistor 10KΩ Type 3, digital 24Vac/dry contact, or 0-10Vdc) 2 digital inputs
Outputs	2 analog outputs (0-10 Vdc or 2-10Vdc; selectable) Up to 4 TRIAC outputs 24 Vac, 500mA max thermal fuse in series with each TRIAC output (on/off, pulse, or 2 floating outputs)
Real Time Clock	Real-time clock (RTC) with super capacitor backup (approximately 3 days)
BACnet	BACnet® MS/TP @ 9600, 19200, 38400 or 76800 bps (B-ASC)
Modbus	Modbus RTU slave @ 9600, 19200, 38400 or 57600. Selectable parity and stop bit configuration: No parity, 2 stop bit Even parity, 1 stop bit Odd parity, 1 stop bit
Communication connection	Low capacitance, EIA RS-485, 22 or 24 AWG shielded twisted pair multi-strand cables (Belden 9841 or equivalent).
Digital Room Sensor connection	Insulated 3 core multi-strand 22 or 24 AWG cable. Maximum 50ft (15m) between controller and digital room sensor.
Electrical connection	Insulated 2 core 0.8 mm ² [18 AWG] minimum power cable.
Operating temperature	0°C to 50°C [32°F to 122°F]
Storage temperature	-30°C to 50°C [-22°F to 122°F]
Relative Humidity	5 to 95% non condensing
Weight	1.26 kg. [2.8 lb]



The actuator performs an auto-stroke on power up. When changing the actuator adjustment screws, cycle power to initiate the auto-stroke.

EVC with a built-in 70 in. lb. Actuator




Dimensions

A = 1.50" | 39mm
B = 7.25" | 185mm
C = 3.25" | 83mm
D = 5.50" | 140mm



Digital Room Sensor Specifications

Description		TRL24 and TDU Series
Temperature Sensor (TRL24 and TDU)		
Setpoint range	10°C to 40°C [50°F to 104°F]	
Control accuracy	Temperature: $\pm 0.4^\circ\text{C}$ [0.8°F]	
Display resolution	$\pm 0.1^\circ\text{C}$ [0.2°F]	
Humidity Sensor (TRLH24, TRLGH24 and TDU models with Humidity Sensors)		
Sensor range	5 to 95%RH	
Display resolution	0.1%	
CO₂ Sensor (TRLG24, TRLGH24 and TDU models with CO₂ Sensors)		
Operating principle	Self-calibrating, Non-Dispersive Infrared (NDIR)	
Sensor Range	0 to 2000 ppm	
Setpoint range	100 to 2000 ppm	
Accuracy	$\pm 30 \text{ ppm} \pm 3\% \text{ of reading}$	
Response time	2 minutes by 90%	
Display resolution	1 ppm	
PIR Motion Sensor (TDU00 / TDU 30 / TDU60 models with PIR Sensor)		
Operating Principle	Passive Infrared (PIR)	
Detection Angle	100°	
Detection Distance	4m [13ft]	
Detection Area		
VOC Sensor (TDU00 / TDU30 / TDU60 models with VOC Sensor)		
Operating Principle	Self-calibrating, Non-Dispersive Infrared (NDIR)	
Sensor Range	0-1000 ppb isobutylene equivalent tVOCs	
Response Time	<5 seconds for tVOC	
Start up Time	15 minutes	
Other		
Electrical connection	3 wires to VAV controller and 2 wires to BACnet/Modbus network 0.8 mm ² [18 AWG] minimum	
Network service port	Mini USB connector	
Power supply	24Vac	
Power consumption	1VA	
Operating temperature	0°C to 50°C [32°F to 122°F]	
Storage temperature	-30°C to 50°C [-22°F to 122°F]	
Relative humidity	5 to 95 % non condensing	
Enclosure protection	IP 30 (EN 60529)	
Weight	120 g. [0.25 lb]	

**Dimensions**

TRL24	
A = 2.85" 73mm B = 4.85" 123mm C = 1.00" 24mm D = 2.36" 60mm E = 3.27" 83mm	
TDU10 / TDU40 / TDU70 Series	
A = 5.24" 133mm B = 2.87" 73mm C = 3.74" 95mm D = 1.22" 31mm E = 0.75" 19mm F = 2.00" 51mm G = 2.18" 55mm	
TDU00 / TDU30 / TDU60 Series	
A = 4.88" 124mm B = 3.25" 83mm C = 1.75" 44mm D = 0.96" 24mm E = 2.07" 53mm F = 2.36" 60mm G = 3.28" 83mm H = 0.78" 20mm (without CO2) 0.95" 24mm (with CO2)	


TDU Models

Horizontal Model #	Temp	RH	CO ₂
TDU10-100	•		
TDU40-100			
TDU70-100			
TDU10-101	•	•	
TDU40-101			
TDU70-101			
TDU10-102	•	•	•
TDU40-102			
TDU70-102			
TDU10-103	•		•
TDU40-103			
TDU70-103			



TDU10 Series



TDU40 Series



TDU70 Series

Vertical Model #	Temp	RH	CO ₂	PIR	VOC
TDU00-100	•				
TDU30-100					
TDU60-100					
TDU00-101	•	•			
TDU30-101					
TDU60-101					
TDU00-102	•	•	•		
TDU30-102					
TDU60-102					
TDU00-103	•		•		
TDU30-103					
TDU60-103					
TDU00-104	•			•	
TDU30-104					
TDU60-104					
TDU00-105	•	•		•	
TDU30-105					
TDU60-105					
TDU00-106	•	•	•		•
TDU30-106					
TDU60-106					
TDU00-107	•	•	•	•	•
TDU30-107					
TDU60-107					
TDU00-108	•	•	•	•	
TDU30-108					
TDU60-108					



TDU00 Series



TDU30 Series




TDU60 Series




Interface

TRL24

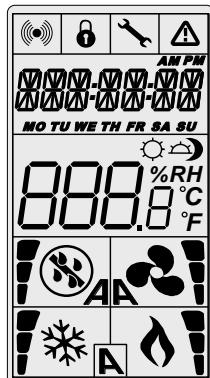


	Cooling ON A: Automatic		Communication Status		Alarm status
	Heating ON A: Automatic		Menu Locked		Energy saving mode (NSB or Occupancy)
	Fan ON A: Automatic		Programming mode (Technician setting)		Percentage of humidity
					°C or °F °C: Celsius scale °F: Fahrenheit scale

TDU10 / TDU40 / TDU70 Series

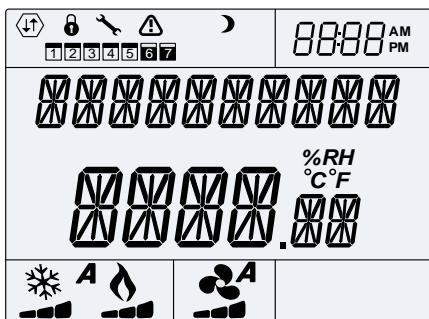

	Network Communication		User Lock		Programming Mode (Technician Setting)
	Alarm Status		Energy Saving Mode (NSB/OCC)		Schedule
	Time		Parts Per Million		°C: Celsius Scale °F: Fahrenheit Scale %RH: Humidity
	Automatic Mode		Cooling		Heating
					Fan

TDU00 / TDU30 / TDU60 Series

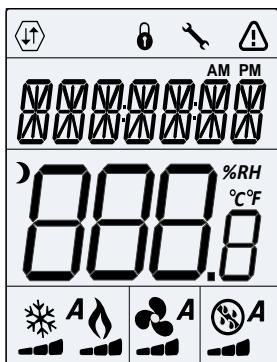


	Network Communication		User Lock		Programming Mode (Technician Setting)
	Alarm Status		Energy Saving Mode (NSB/OCC)		Time
	°C: Celsius Scale °F: Fahrenheit Scale %RH: Humidity		Automatic Mode		Cooling
	Heating				Fan

Mechanical Installation - Actuator

- Manually close the damper blades and position the actuator to 0° or 90°.
- Slide the actuator onto the shaft.
- Tighten the nuts on the "U" bolt to the shaft with an 8mm wrench to a torque of 60 in-lb [6.7 Nm].
- Slide the mounting bracket under the actuator. Ensure free movement of the slot at the base of the actuator. Place the bracket pin at mid distance of the slot.
- Affix the bracket to the ductwork with #8 self-tapping screws.

Do not press the clutch when the actuator is powered.

EVC with a built-in 70 in. lb. Actuator

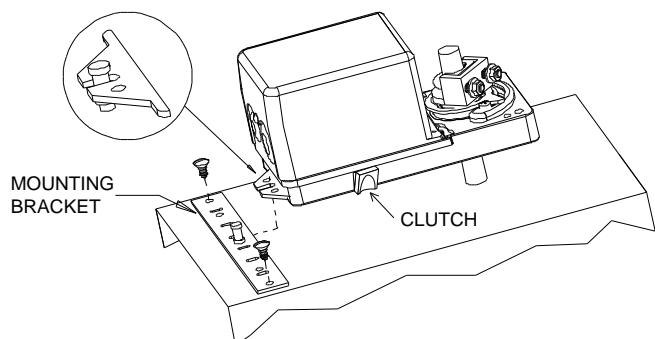




Mounting Instructions

TRL24



CAUTION: Remove power to avoid a risk of malfunction.

- A. Remove the captive screw that's holding the base and the front cover of the unit together.
- B. Lift the front cover of the unit to separate it from the base.
- C. Pull all wires through the holes in the base.
- D. Secure the base to the wall using wall anchors and screws (supplied). Make the appropriate connections.
- E. Mount the control module on the base and secure using the screw.

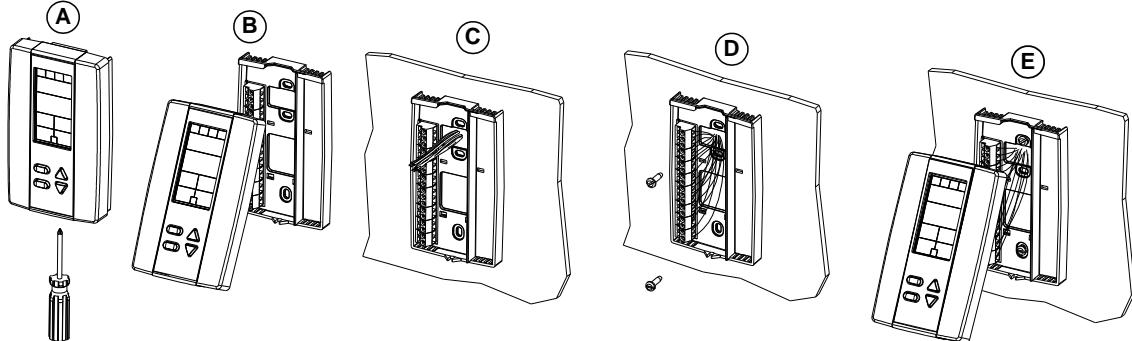


TDU10 / TDU40 / TDU70 Series



CAUTION: Remove power to avoid a risk of malfunction.

- A. Remove the wall mounting plate (highlighted) from the back of the digital room sensor.
- B. Install the mounting plate on the gang box.
- C. Pull the wires through the base hole and make the appropriate connections.
- D. Mount the digital room sensor onto the wall plate. To mount it correctly, place the top of the digital room sensor on the mounting plate first and push it into the grooves to snap it into place.
- E. Secure the digital room sensor using the screw (supplied).

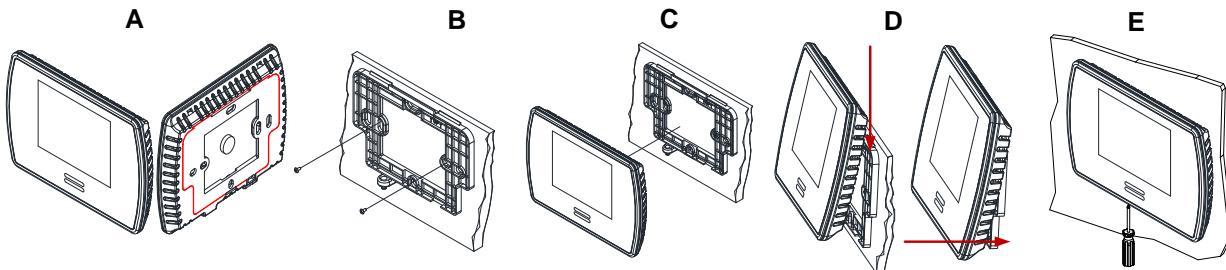


TDU00 / TDU30 / TDU60 Series



CAUTION: Remove power to avoid a risk of malfunction.

- A. Remove the captive screw that's holding the base and the front cover of the unit together.
- B. Lift the front cover of the unit to separate it from the base.
- C. Pull all wires through the holes in the base.
- D. Secure the base to the wall using wall anchors and screws (supplied). Make the appropriate connections.
- E. Mount the control module on the base and secure using the screw.

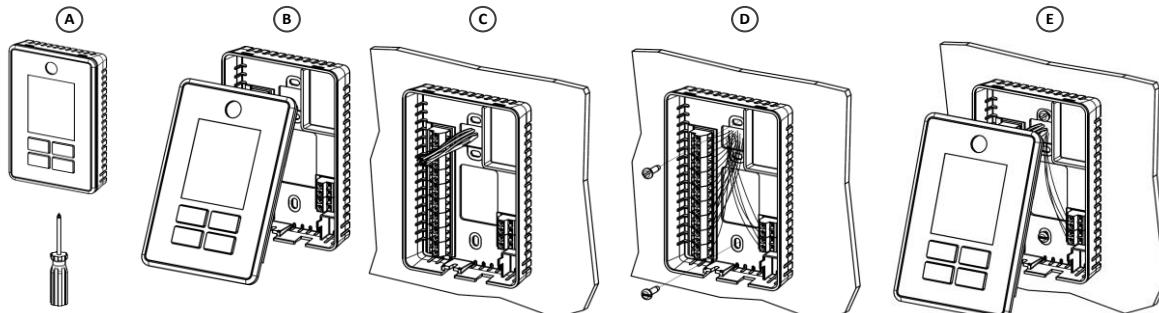

**BACnet or Modbus Address DIP Switch (DS1)**

MAC address for communication, are selectable by DIP switch using binary logic. If you do not change device instance in program mode, it will be automatically modified according to the MAC address.



Note: Avoid using addresses above 246 when selecting Modbus MAC address.

MAC Address	DS.1 = 1	DS.2 = 2	DS.3 = 4	DS.4 = 8	DS.5 = 16	DS.6 = 32	DS.7 = 64	DS.8 = 128	Default Device Instance
0	OFF	OFF	OFF	OFF	OFF	OFF	OFF	OFF	153000
1	ON	OFF	OFF	OFF	OFF	OFF	OFF	OFF	153001
2	OFF	ON	OFF	OFF	OFF	OFF	OFF	OFF	153002
3	ON	ON	OFF	OFF	OFF	OFF	OFF	OFF	153003
4	OFF	OFF	ON	OFF	OFF	OFF	OFF	OFF	153004
...
126	OFF	ON	ON	ON	ON	ON	ON	OFF	153126
127	ON	ON	ON	ON	ON	ON	ON	OFF	153127


* Slave addresses available by setting DS.8 to ON



Wiring

We strongly recommend that all Nepronic products be wired to a separate grounded transformer and that transformer shall service only Nepronic products. This precaution will prevent interference with, and/or possible damage to incompatible equipment.

TRL24 and TDU

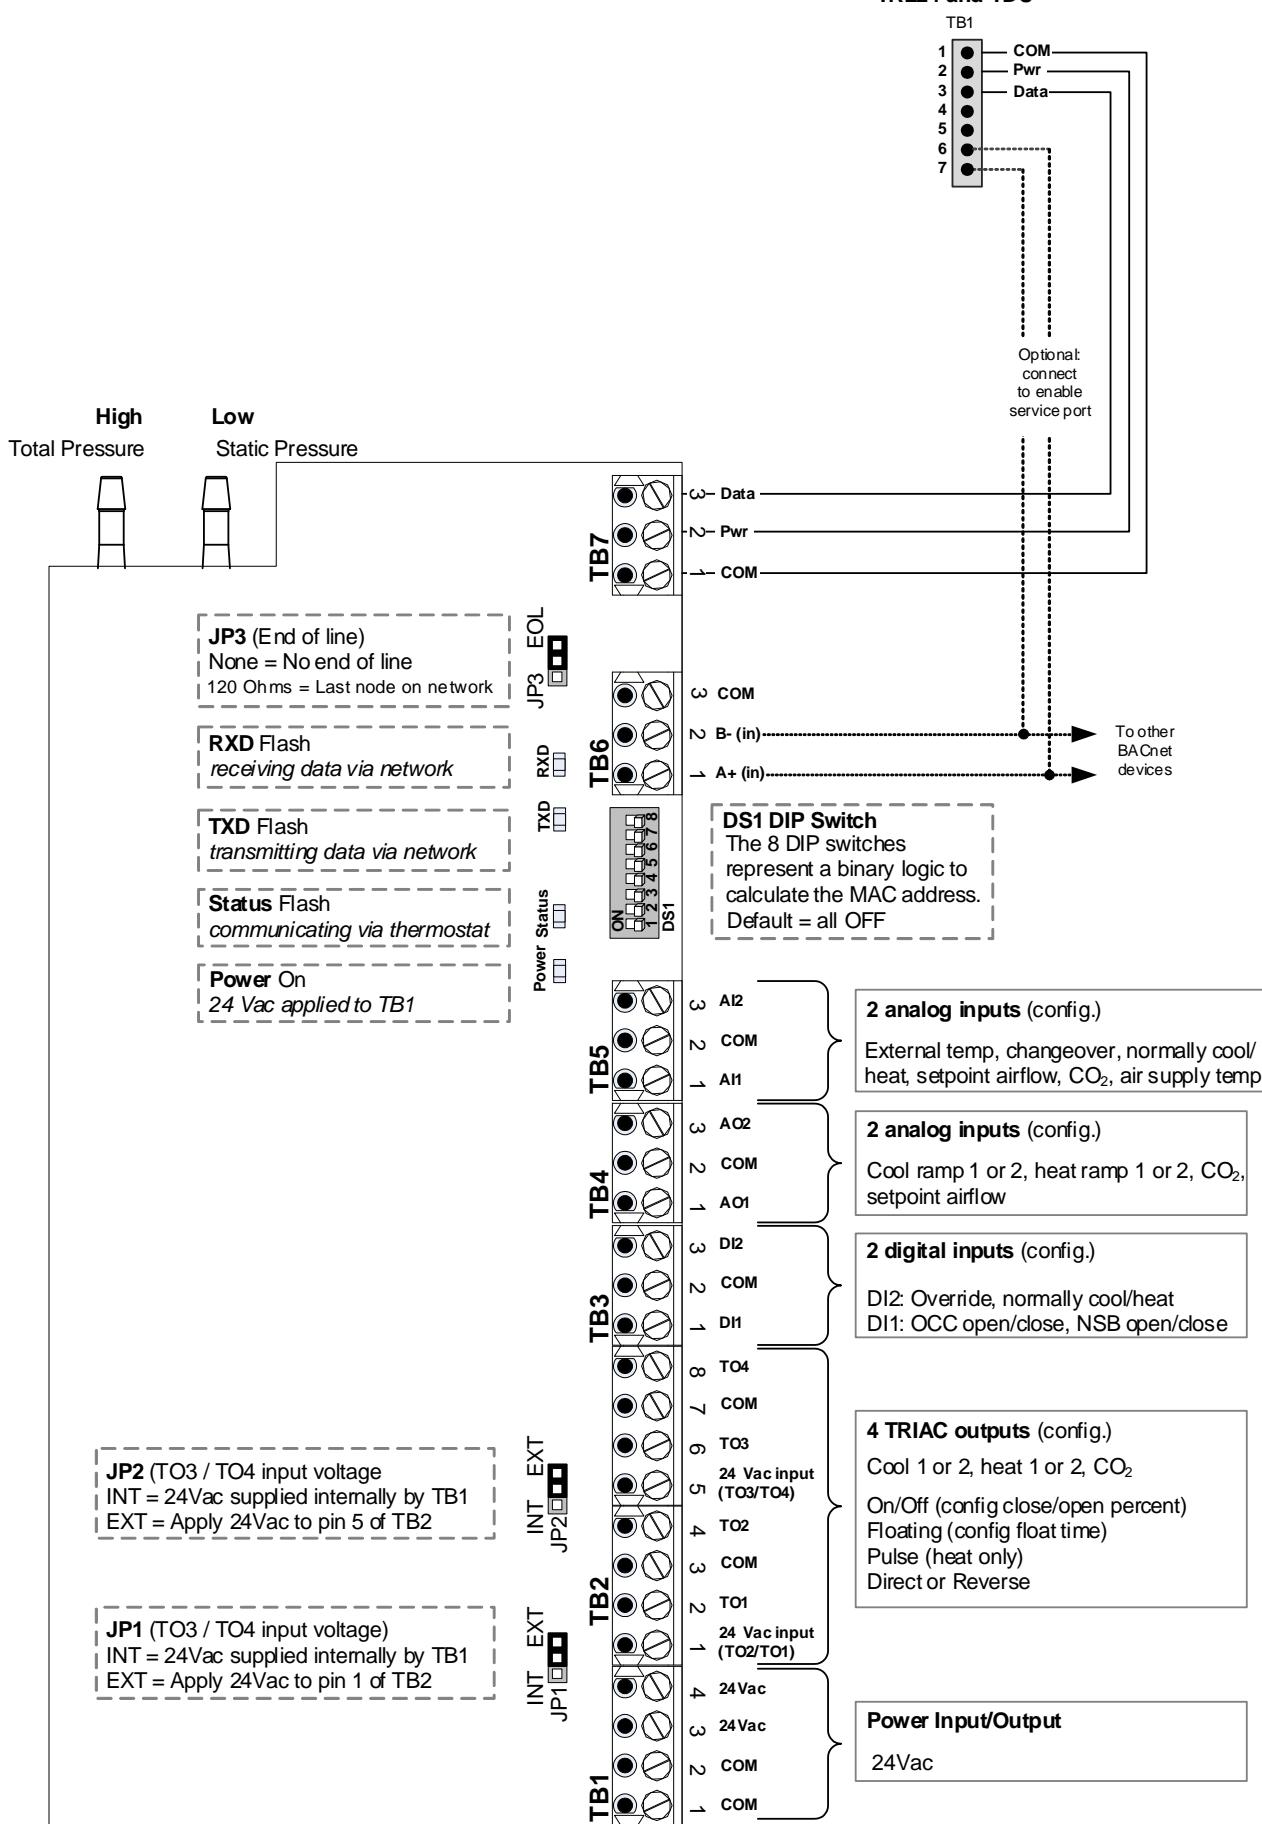




PCB Drawings

TRL24 Digital Room Sensor

3 wire cable (TB1 #1, 2 & 3)

Connect TB1 #6 (A+) & #7 (B-) to EVCB to enable the BACnet service port.

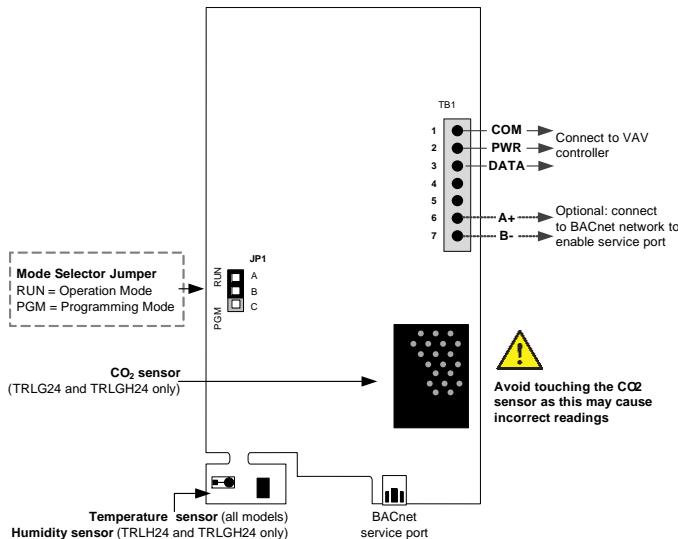


Mode Selection (JP1)

JP1	RUN: Digital room sensor is in <u>Operation Mode</u> . Digital room sensor must be set in this mode for normal system operation. If not locked, setpoint and control mode can be changed by the end user.
JP1	PGM: Digital room sensor is set in <u>Programming Mode</u> . Refer to the following sections for more details.

TDU10 / TDU40 / TDU70 Series Digital Room Sensor

3 wire cable (TB1 #1, 2 & 3)

Connect TB1 #6 (A+) & #7 (B-) to EVCB to enable the BACnet service port.

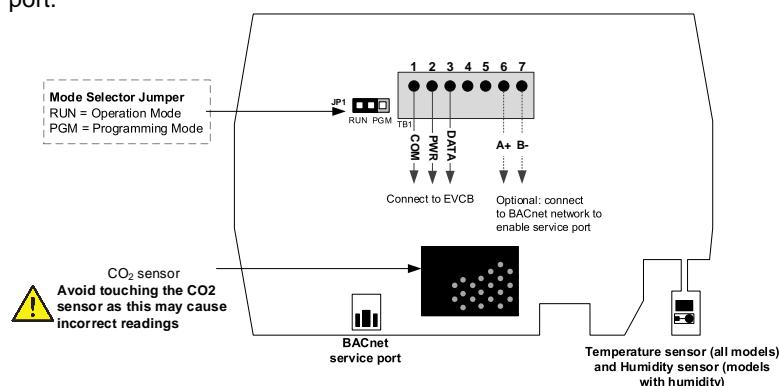


Mode Selection (JP1)

JP1	RUN: Digital room sensor is in <u>Operation Mode</u> . Digital room sensor must be set in this mode for normal system operation. If not locked, setpoint and control mode can be changed by the end user.
JP1	PGM: Digital room sensor is set in <u>Programming Mode</u> . Refer to the following sections for more details.

TDU00 / TDU30 / TDU60 Series Digital Room Sensor

3 wire cable (TB1 #1, 2 & 3)

Connect TB1 #6 (A+) & #7 (B-) to EVCB to enable the BACnet service port.

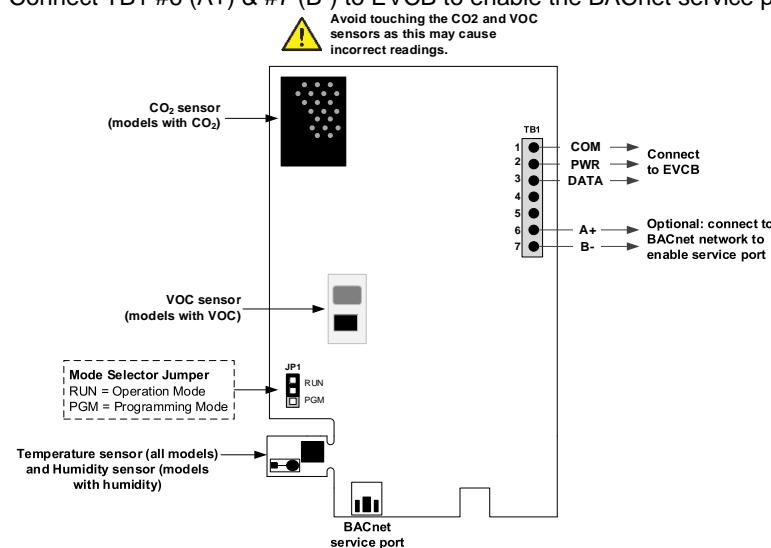

Mode Selection (JP1)

JP1	RUN: Digital room sensor is in <u>Operation Mode</u> . Digital room sensor must be set in this mode for normal system operation. If not locked, setpoint and control mode can be changed by the end user.
JP1	PGM: Digital room sensor is set in <u>Programming Mode</u> . Refer to the following sections for more details.



Access to Menus

The menu overviews and options are the same for both TRL24 and TDU digital room sensors. However, the action button or the button used to access the menus and save changes is different in the digital room sensors. Use the following menu overviews with the appropriate action button as per your digital room sensor.

Action Buttons on Digital Room Sensor


Action Button		Task
TRL24	TDU	
		Press to access the programming menus and save any changes.
		Press to return to the previous step without saving.


 Note: Prior to going into Programming Mode, remove the connection cable between the EVCB and the TRL/TDU and set the Mode Selection jumper (JP1) to PGM on the digital room sensor. Reestablish the connection in order to access the programming menus and to make any changes. Once all menu changes have been made, remove the connection cable again before setting jumper JP1 back to RUN, and then reconnect the cable to resume normal operation.




Pressure & Applications – Menu (1 of 6) | Pressure and Applications





For a description of the default settings for each application refer to Annex A: Control Apps on page 22.

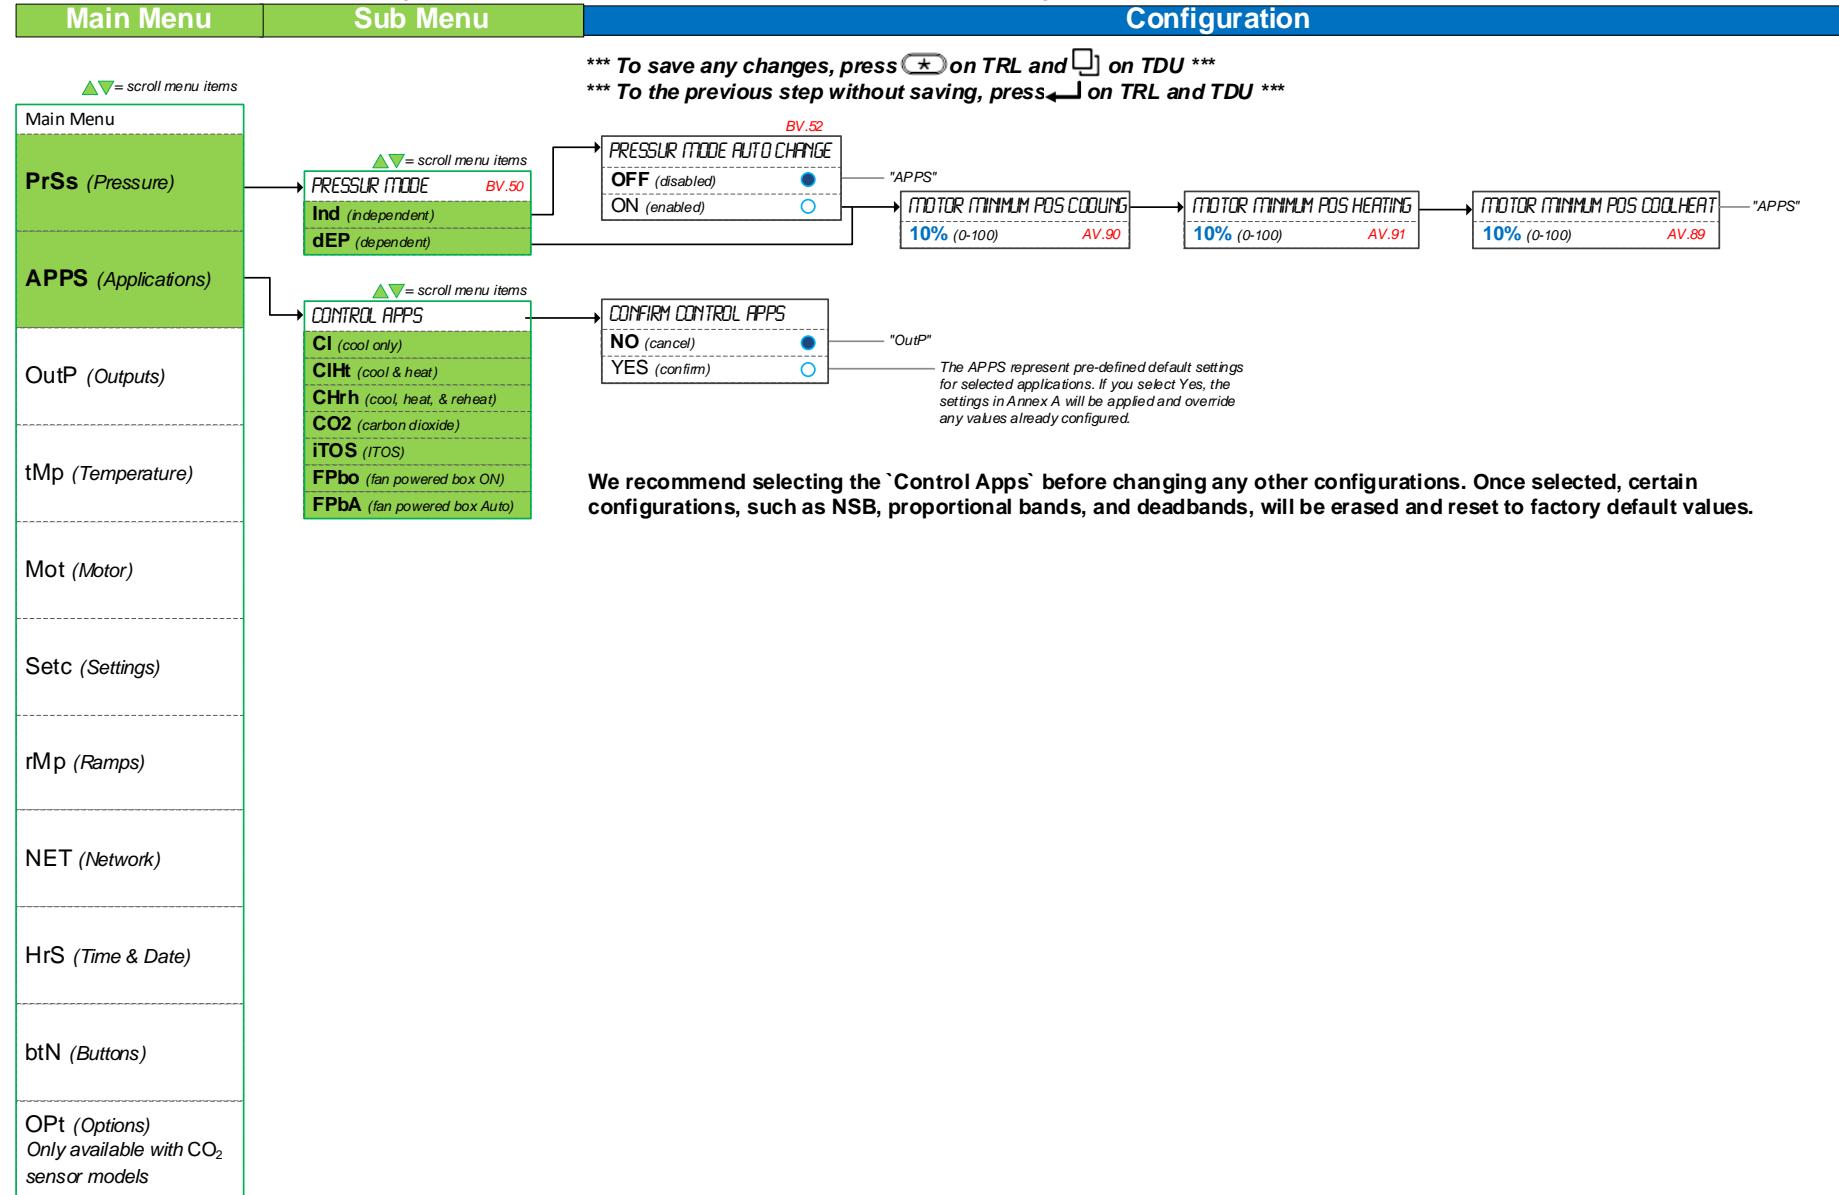

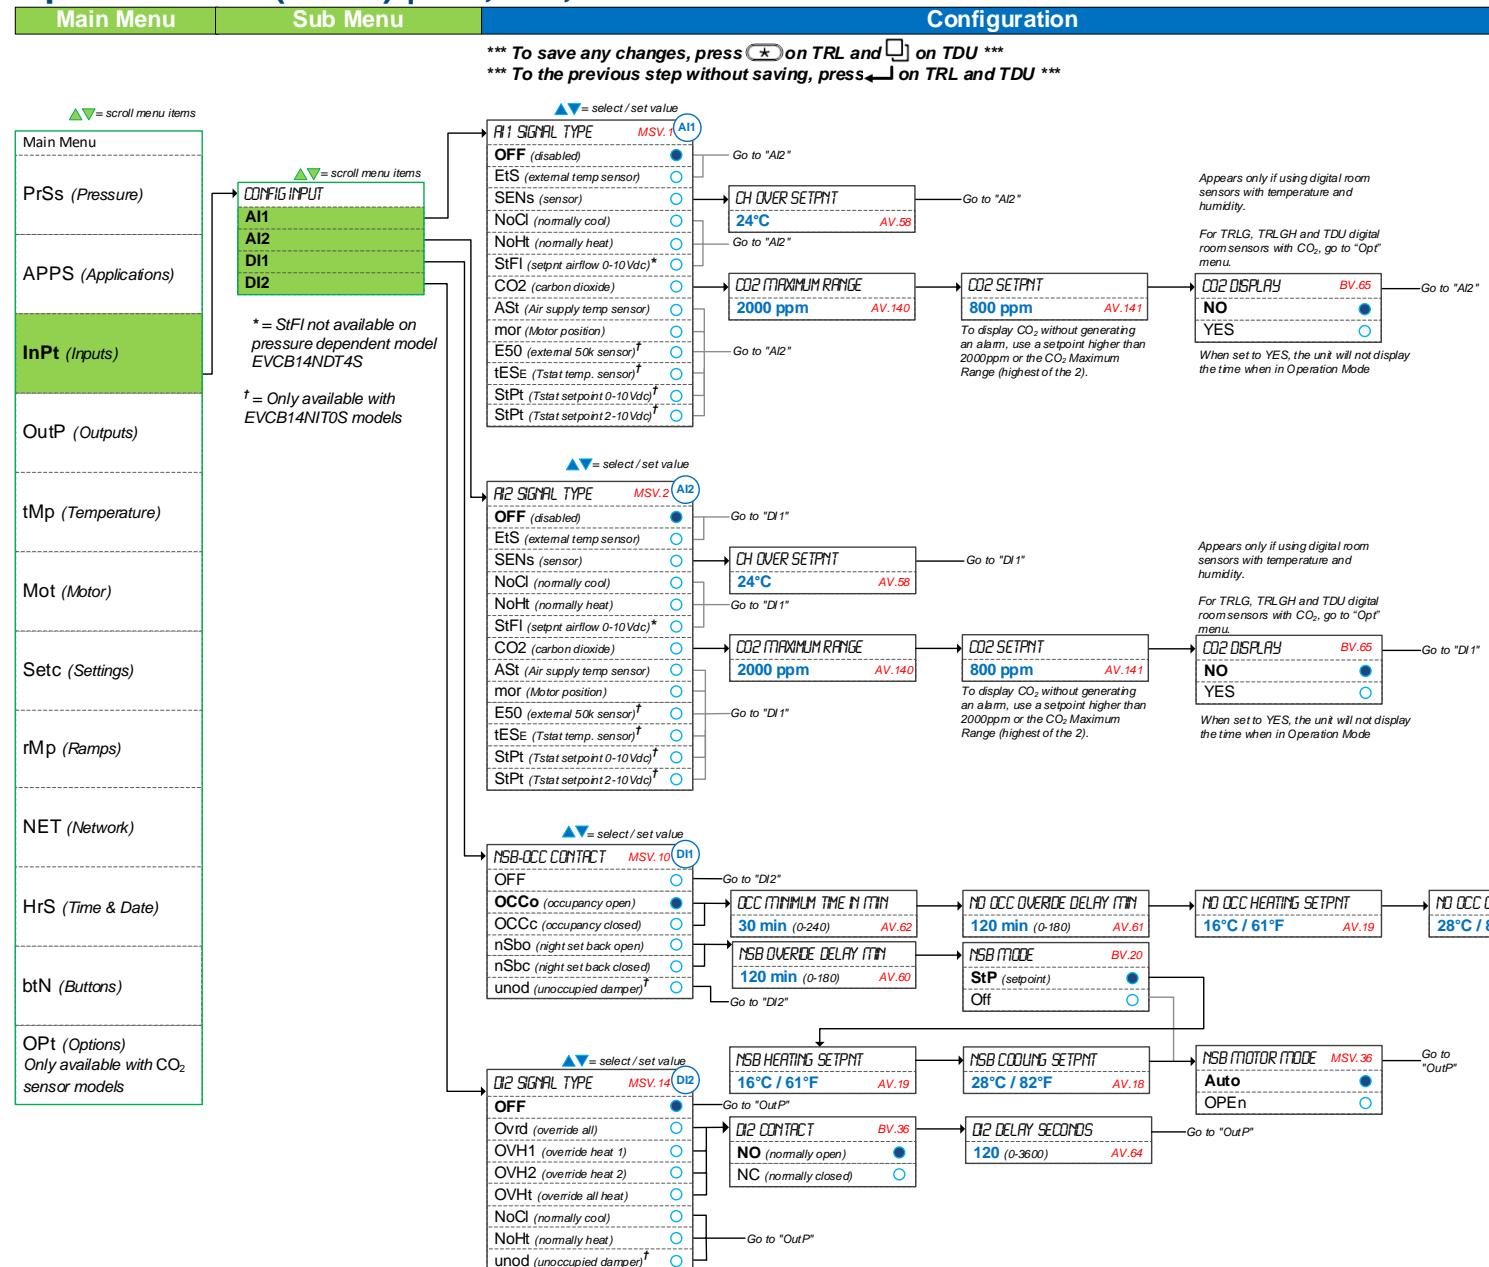Inputs – Menu (2 of 6) | AI1, AI2, DI1 and DI2

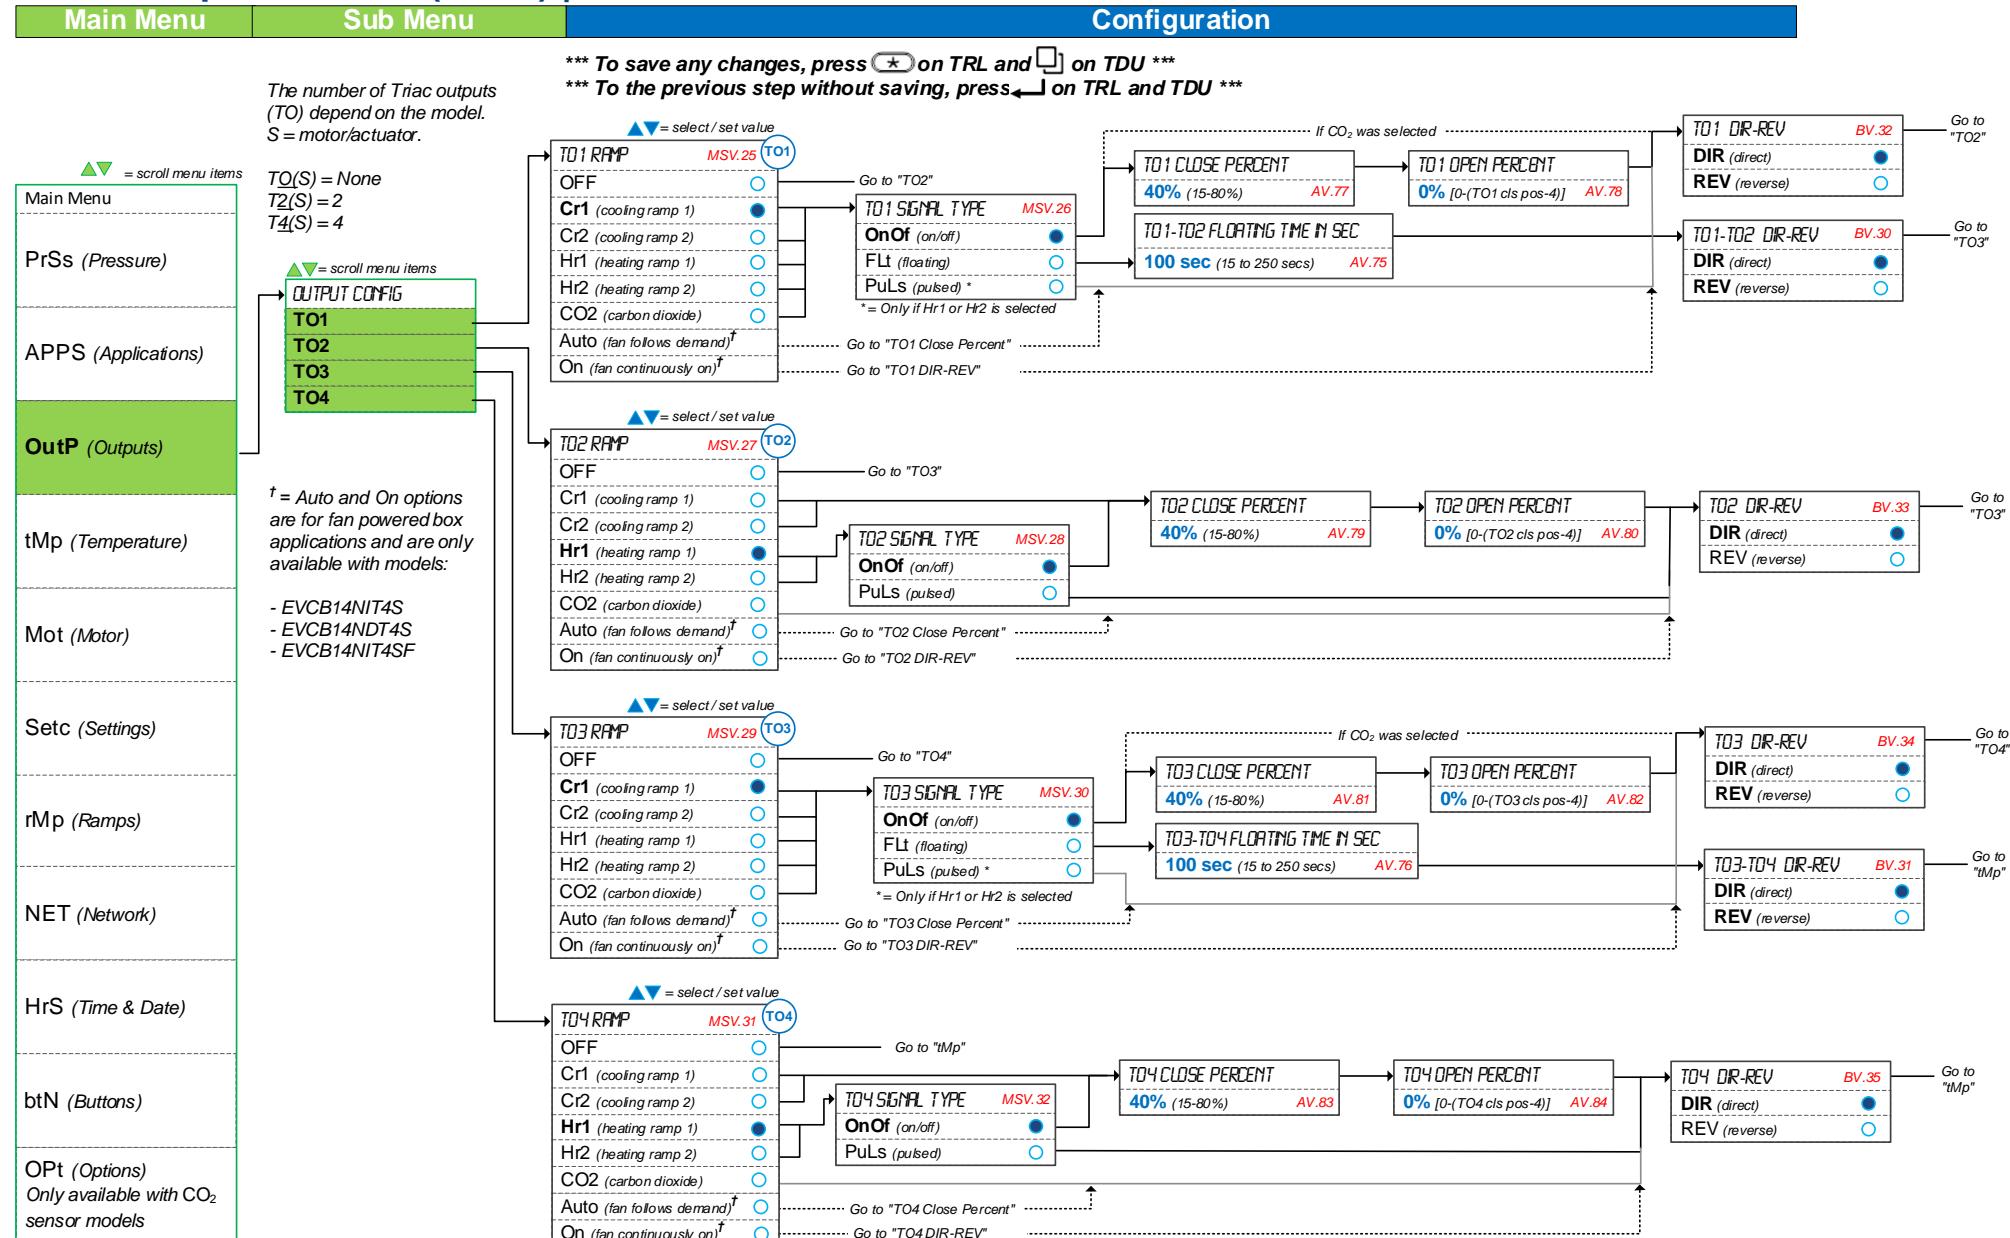
TRIAC Outputs – Menu (3 of 6) | TO1 to TO4


Analog Outputs – Menu (4 of 6) | AO1 and AO2

Main Menu	Sub Menu	Configuration
 Main Menu <ul style="list-style-type: none"> PrSS (Pressure) APPS (Applications) InPt (Inputs) OutP (Outputs) <ul style="list-style-type: none"> TO1 TO2 TO3 TO4 AO1 AO2 tMp (Temperature) Mot (Motor) Setc (Settings) <ul style="list-style-type: none"> - EVCB14NIT4S - EVCB14NDT4S - EVCB14NIT4SF rMp (Ramps) NET (Network) HrS (Time & Date) btN (Buttons) OPt (Options) Only available with CO₂ sensor models 	 OUTPUT CONFIG <ul style="list-style-type: none"> TO1 TO2 TO3 TO4 AO1 AO2 <p><i>§ = For models EVCB14NIT0S, the default value is Hr1</i></p> <p><i>* = StFl not available on pressure dependent model EVCB14NDT4S</i></p> <p><i>† = Auto and On options are for fan powered box applications and are only available with models:</i></p> <ul style="list-style-type: none"> - EVCB14NIT4S - EVCB14NDT4S - EVCB14NIT4SF 	<p>*** To save any changes, press  on TRL and  on TDU ***</p> <p>*** To the previous step without saving, press  on TRL and TDU ***</p> <p> = select / set value</p> <p>AO1 RAMP MSV.20 AO1</p> <p>OFF Cr1 (cooling ramp 1) Cr2 (cooling ramp 2) Hr1 (heating ramp 1) Hr2 (heating ramp 2) ArFl (airflow reading) CO2 (carbon dioxide) StFl (stpt airflow 0-10Vdc)* Auto (fan follows demand) On (fan continuously on)</p> <p>Go to "AO2"</p> <p>AO1 MINIMUM VOLTAGE 0.0 Vdc AV.70</p> <p>AO1 MAXIMUM VOLTAGE 10.0 Vdc AV.71</p> <p>AO1 DIR-REV BV.25</p> <p>DIR (direct) REV (reverse)</p> <p>Go to "AO2"</p> <p> = select / set value</p> <p>AO2 RAMP MSV.22 AO2</p> <p>OFF Cr1 (cooling ramp 1) Cr2 (cooling ramp 2) Hr1 (heating ramp 1) Hr2 (heating ramp 2) ArFl (airflow reading) CO2 (carbon dioxide) StFl (stpt airflow 0-10Vdc)* Auto (fan follows demand) On (fan continuously on)</p> <p>Go to "tmp"</p> <p>AO2 MINIMUM VOLTAGE 0.0 Vdc AV.72</p> <p>AO2 MAXIMUM VOLTAGE 10.0 Vdc AV.73</p> <p>AO2 DIR-REV BV.26</p> <p>DIR (direct) REV (reverse)</p> <p>Go to "tmp"</p>


Settings – Menu (5 of 6) | Temp, Motor, Settings and Ramps

Main Menu

Sub Menu


Configuration

*** To save any changes, press on TRL and on TDU ***
*** To the previous step without saving, press on TRL and TDU ***

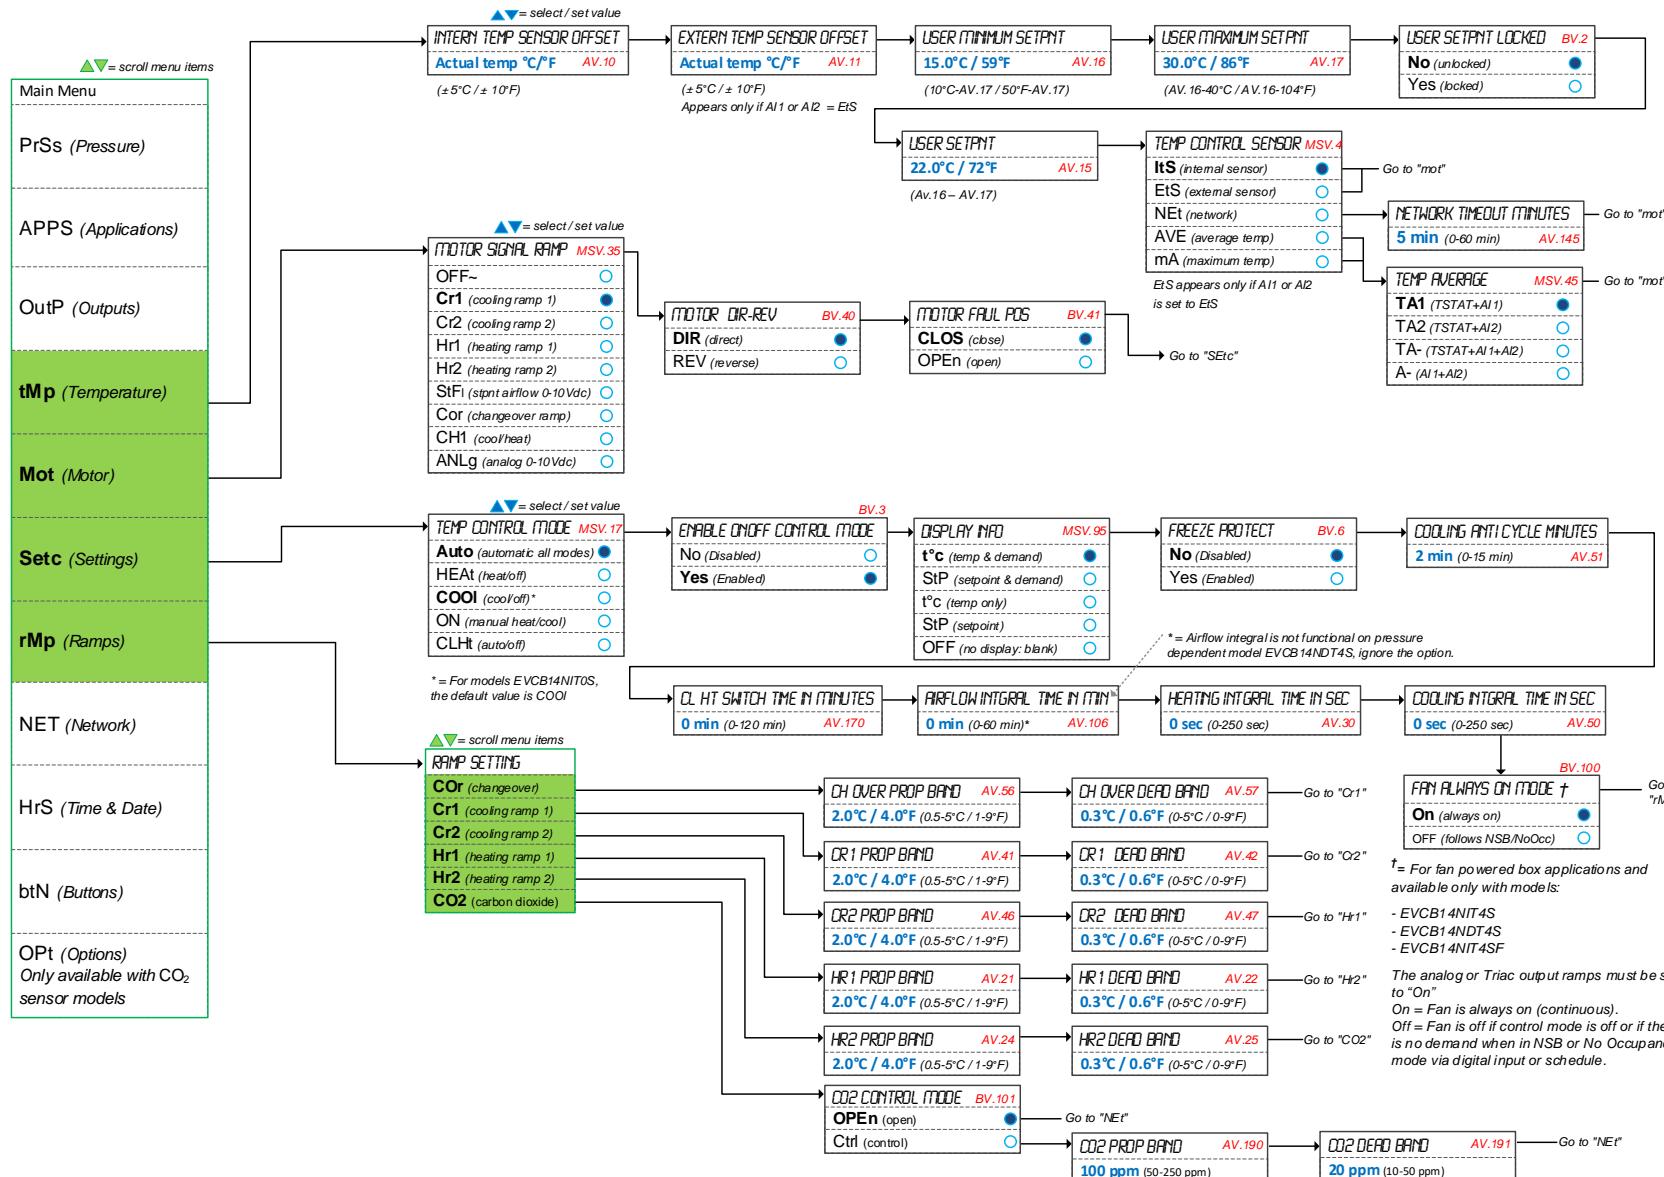

Settings – Menu (6 of 6) | Network, Time, Buttons and Options

Main Menu Sub Menu Configuration

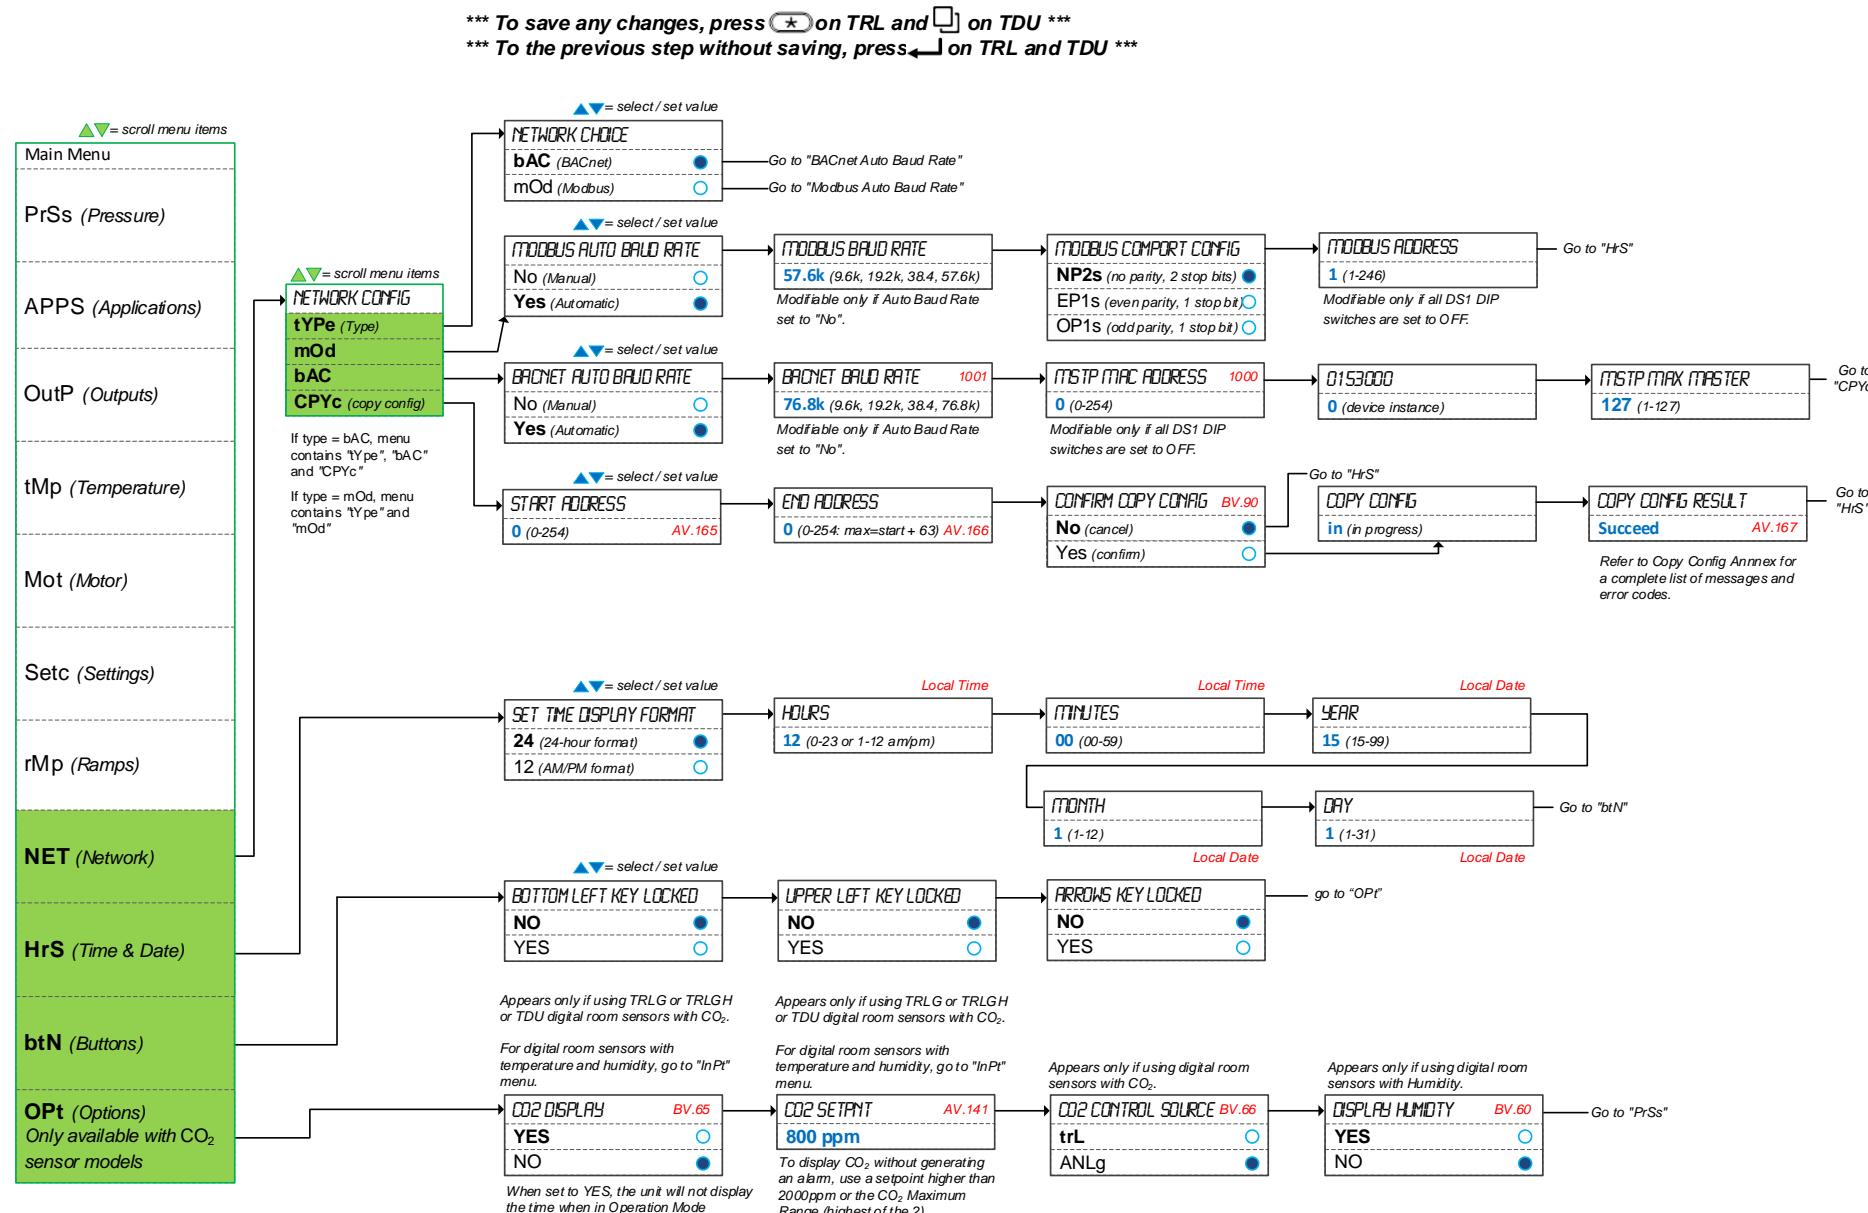



Operation Menus

This menu is accessible through normal operation mode. The Mode Selector jumper (JP1) of the digital room sensor must be set to the "RUN" position (Operation Mode). Refer to [Wiring](#) on page 9.

Note: Since the action buttons are different on TRL and TDU digital room sensor series, both buttons have been included in the instructions. Refer to the [Action Buttons on Digital Room Sensor](#) section to know and use the button as available on your digital room sensor.

1. Press the **[*] / []** and **[←]** buttons simultaneously for 5 seconds. The "ENTER PASSWORD" screen appears.
2. Enter the password within 1 minute by using the arrow keys to increase or decrease the value and the **[*] / []** and **[←]** buttons to toggle between the digits.
 - a. Password **372** = Temperature Offset Menu
 - b. Password **637** = Network Settings Menu
 - c. Password **757** = Airflow Balance Mode
3. If you enter the wrong password, the digital room sensor displays "Eror" and returns to Operation Mode. The digital room sensor will return to normal mode if you navigate through the entire menu and do not make any selection, or if you do not press any key for 5 minutes. The changed values will be saved automatically.

Menu 372 – Temperature Offset

1. "INTERN TEMP SENSOR OFFSET"



Range: 10 to 40°C [50 to 104°F]
Offset: Max ± 5°C
Increment: 0.1°C [0.2°F]

Compare the displayed temperature reading with a known value from a digital room sensor. To offset or calibrate the sensor, use the arrows key to set the desired temperature reading. This is useful for digital room sensors installed in areas where the temperature read is slightly different than the room's actual temperature. For example, a digital room sensor placed right under the air diffuser.

If the digital room sensor is set to use an external temperature sensor (EtS), the digital room sensor displays "OFF".

2. "EXTERN TEMP SENSOR OFFSET"



Range: 0 to 50°C [41 to 122°F]
Offset: Max ± 5°C
Increment: 0.1°C [0.2°F]

This option appears if you've set one of the analog inputs to **EtS** (External temperature sensor). When the digital room sensor is connected to the appropriate analog input, the display shows the temperature read by the external temperature sensor.

Adjust the offset by comparing it with a known value (e.g. thermometer). If the sensor is not connected or short circuited, then the unit displays the sensor's limit.

3. "INPUT3 READING"



Range: 250mV (0") to 4000mV (1")

Displays the voltage output value in mV of the pressure sensor. Does not appear for EVCB14NDT4S (pressure dependent).


4. "INPUT3 MINIMUM READING"



Range: 10mV to 180mV
Default: 60mV


This setting represents the deadband of the pressure sensor in mV. For advanced users or special applications only. We recommend that you use the default setting of 60mV. Does not appear for EVCB14NDT4S (pressure dependent) model.

Menu 637 – Network Settings

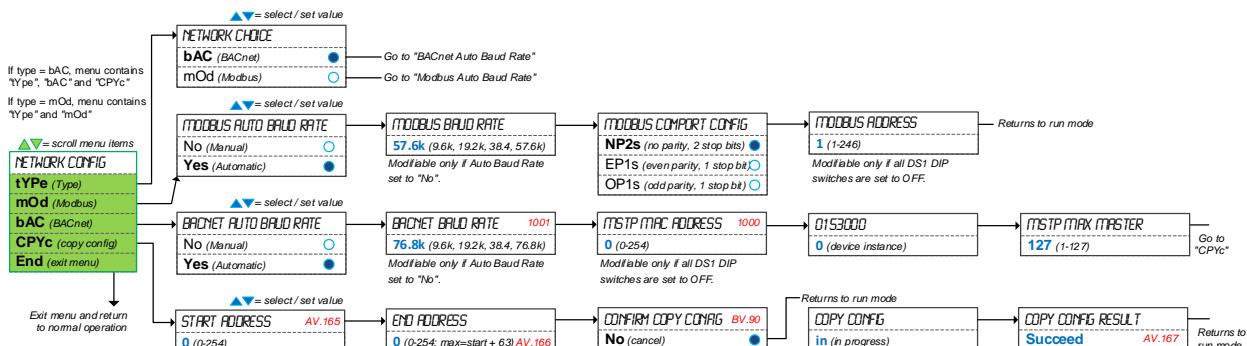


Menu 757 – Airflow Balance Mode

Pressure Independent: models EVCB14NIT0S, EVCB14NIT2S, and EVCB14NIT4S

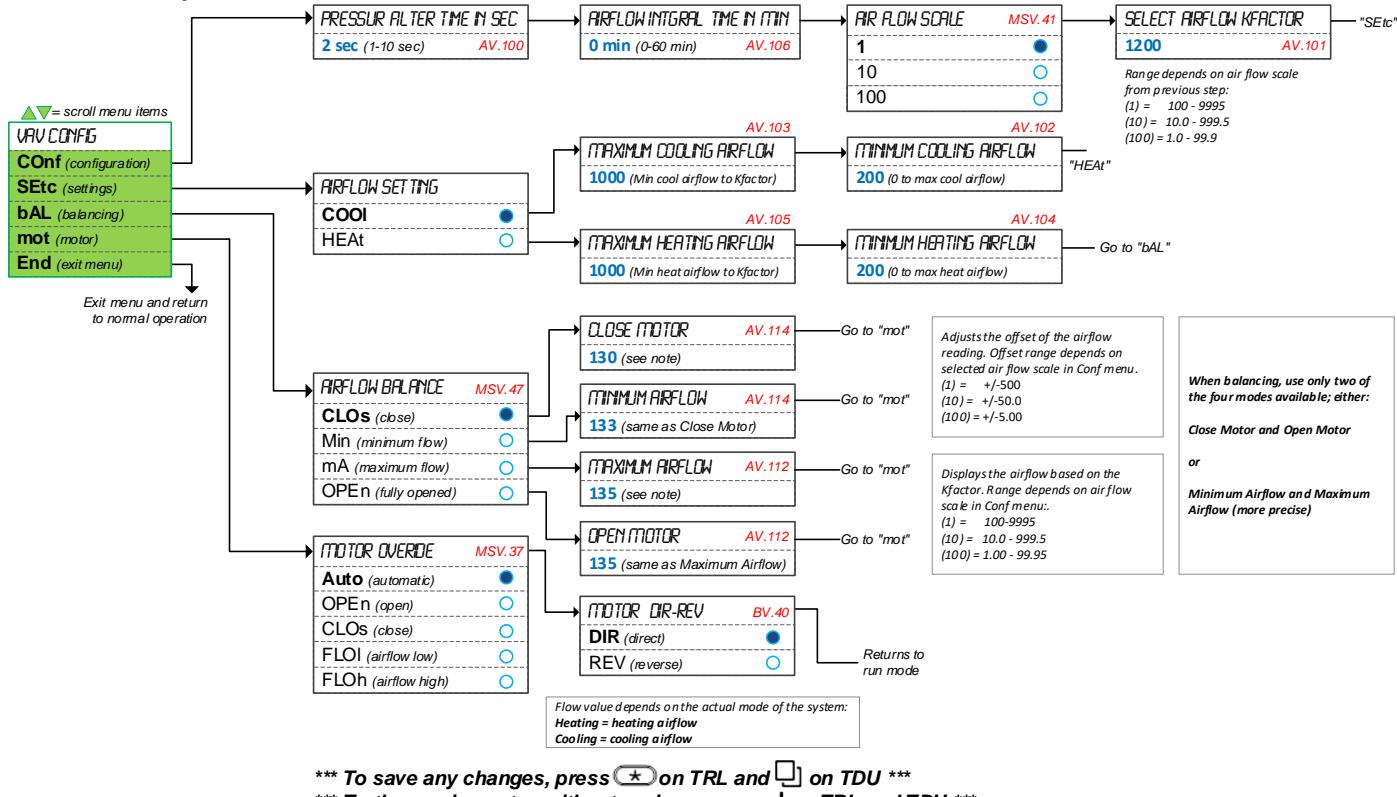

Note: Refer to **EVCB-Airflow Balance Instructions** on Neptronic website for further information on airflow balancing function.

Pressure dependent model EVCB14NDT4S or other models if in pressure dependent mode

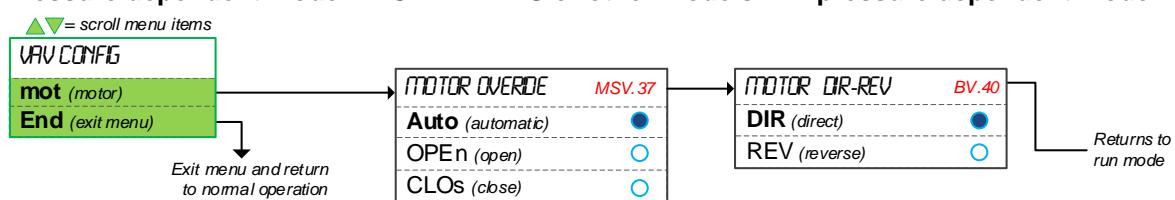

*** To save any changes, press  on TRL and  on TDU ***
*** To the previous step without saving, press  on TRL and TDU ***

Reset to Factory Default Settings



This will erase all actual configurations and replace them with the factory default settings.


1. The Mode Selector jumper (JP1) of the digital room sensor must be set to the “RUN” position (Operation Mode). Refer to [Wiring](#) on page 9.
2. During the power up sequence of the controller and digital room sensor, press and hold both the  and  buttons.
3. The “Enter Password” screen appears. Enter **372** within 1 minute by using the arrow keys to increase or decrease the value and the  /  and  buttons to toggle between the digits.
4. Use the arrow buttons to select YES and then press  / .




Operation Mode

The Mode Selector Jumper (JP1) of the digital room sensor must be set to the “RUN” position (Operation Mode). Refer to [Wiring on page 7](#).


TRL24

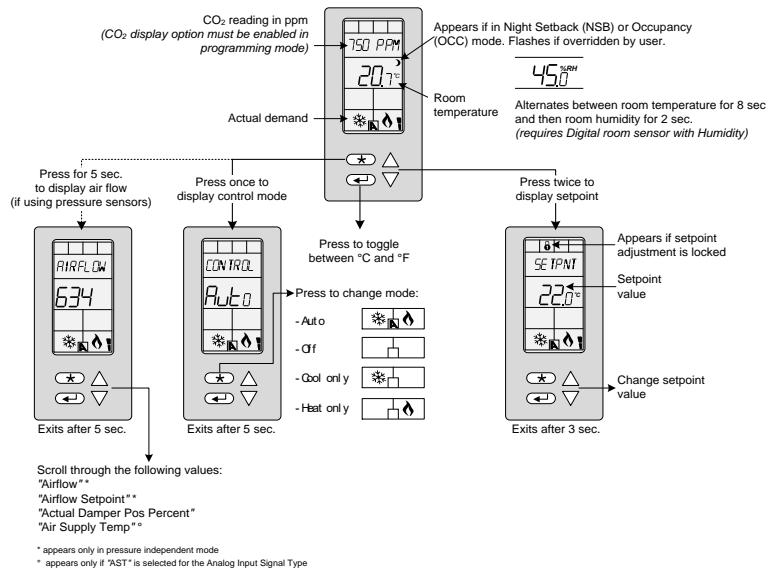

TDU10 / TDU40 / TDU70 Series

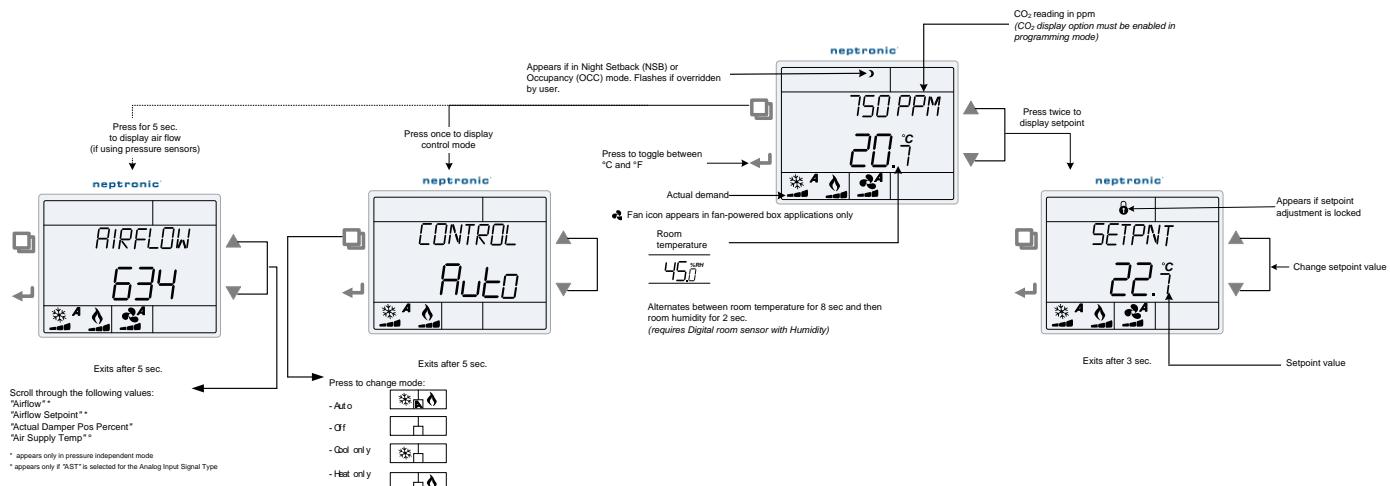

TDU00 / TDU30 / TDU60 Series

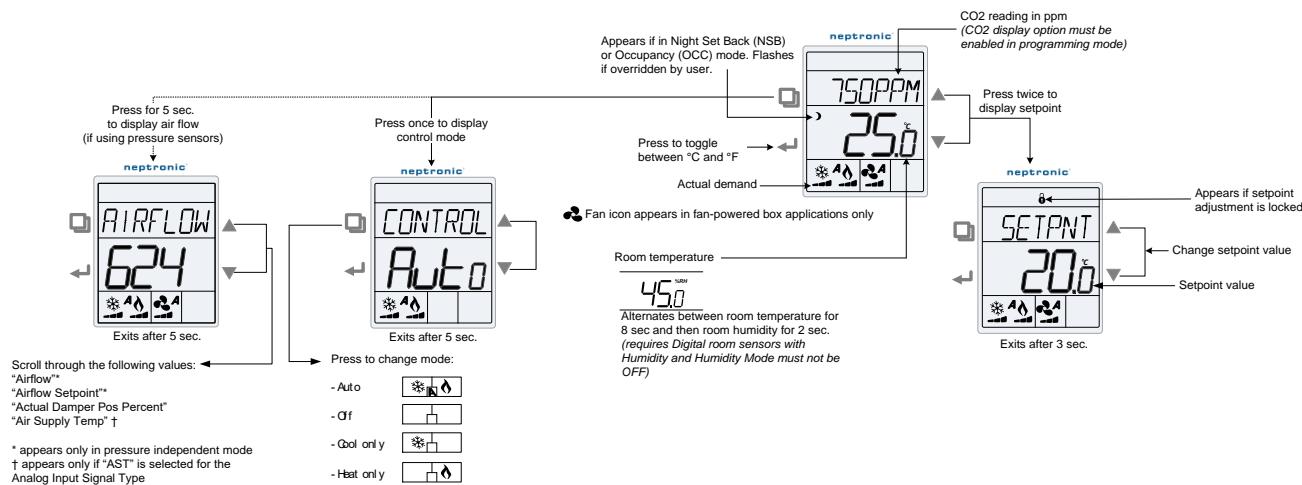



Power Up

Upon power up, the LCD illuminates and all segments appear for 2 seconds. The digital room sensor then displays its current version of the digital room sensor for 2 seconds followed by the current version of the controller for 2 seconds. Pressing any key on the digital room sensor illuminates the LCD for 4 seconds.

CO₂ (Digital Room Sensors with CO₂)

If enabled via the configuration menu, the digital room sensor displays the CO₂ reading on the first line above the temperature reading. If CO₂ display is enabled, the time will not be displayed.

Temperature Display and Setpoint

If enabled in the "Display Info" menu (see *Settings – Menu (5 of 6) | Temp, Motor, Settings and Ramps* on page 16), the digital room sensor displays the temperature reading. If the sensor is disconnected or short circuited, then the unit displays the sensor's limit. To toggle the temperature scale between °C and °F, press the \leftarrow button. To display the setpoint, press the \blacktriangle or \blacktriangledown key twice. The setpoint appears for 5 seconds. To adjust the setpoint, press the arrow keys while the temperature is displayed. If the setpoint adjustment has been locked "Setptn Locked", the lock \mathbb{L} symbol appears.

Humidity

If enabled in the "Options" menu (see *Settings – Menu (6 of 6) | Network, Time, Buttons and Options* on page 17), the digital room sensor displays the temperature reading for 8 seconds and then displays the humidity reading for 2 seconds. If the sensor is disconnected or short circuited, then the unit displays the sensor's limit.

Airflow and Air Supply Temperature

Press and hold the $[\star / \square]$ button for 5 seconds and use the arrow keys to view the "AIRFLOW", "AIRFLOW SETPNT", "actual damper pos percent" and "air Supply Temp". After 5 seconds without any action, the digital room sensor returns to operation mode. The air supply temperature appears only if analog input AI1 or AI2 are configured with the AST option. Not available on the following pressure dependent model *EVCB14NDT4S*.

Control Mode

To access the Control Mode, press the $[\star / \square]$ button. The Control Mode appears for 5 seconds. Press the $[\star / \square]$ button to scroll through the following control modes. These options can vary depending on the options selected in "Temp Control Mode" and "Enable OnOff Control Mode".

- Auto (Automatic Cooling or Heating)
- OFF (if it is not disabled in Programming Mode)
- Cooling only (on, with cooling symbol)
- Heating only (on, with heating symbol)


Night Setback (NSB) or Occupancy Mode

This function is only available if you set DI1 to **nSb** (Night setback contact) or **Occ** (occupancy mode). If the DI1 contact is triggered, the digital room sensor enters NSB or No Occupancy Mode (the \triangleright symbol appears) and uses the NSB or OCC heating and cooling setpoints.

If not locked, you can override the night setback or no occupancy mode for a predetermined period by pressing any of the 4 buttons. During the override period the \triangleright symbol will flash. If the \triangleright symbol does not flash, the override period is finished or the night setback or no occupancy override has been locked in programming mode.

Set Time and Date

1. Ensure that JP1 on the digital room sensor is set to run.
2. Press and hold the \leftarrow button for 5 seconds
3. Use the arrow keys to set the desired value. Press the $[\star / \square]$ button to save and go to the next step. Press the \leftarrow button to go to the previous step without saving.

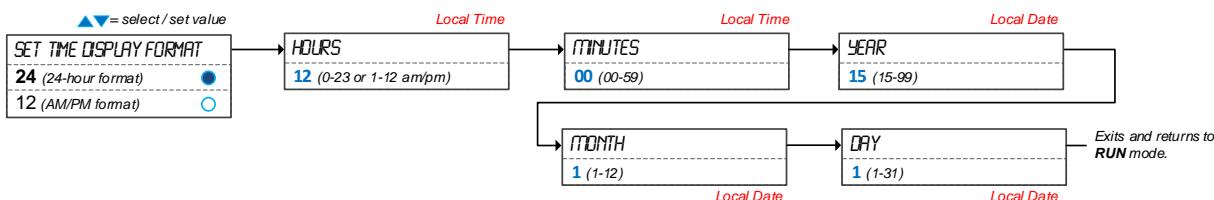

*** To save any changes, press \star on TRL and \square on TDU ***

*** To the previous step without saving, press \leftarrow on TRL and TDU ***

Note: Time will only be displayed on the TDU when the Bacnet scheduler is active. In order to achieve this, set the proper BACnet Object present value to Yes (1): *EVCB.BV.70 – Cfg_ActiveSchedule*.



Annex A: Control Apps

Refer to *Pressure & Applications – Menu (1 of 6)* on page 12 for more information. The available **Control Apps** vary according to the model.

Description	CL (cool only)	CLHt (cool/heat)	CHrH (cool/heat/reheat)	CO ₂ (CO ₂)	ITOS (ITOS)	FPbo (fan powered ON)	FPbA (fan powered Auto)
Min. Setpoint	20°C (68°F)	20°C (68°F)	20°C (68°F)	20°C (68°F)	15°C (59°F)	15°C (59°F)	15°C (59°F)
Max. Setpoint	28°C (82°F)	28°C (82°F)	28°C (82°F)	28°C (82°F)	30°C (86°F)	30°C (86°F)	30°C (86°F)
Changeover Setpnt	24°C (75°F)	20°C (68°F)	20°C (68°F)	20°C (68°F)	24°C (75°F)	24°C (75°F)	24°C (75°F)
TO1 Ramp	HR1	CR1	HR1	CR1	OFF	HR1	HR1
TO1 Signal Type	On/Off	On/Off	On/Off	On/Off	On/Off	On/Off	On/Off
TO1 Close Pos.	40%	40%	40%	40%	40%	35%	35%
TO1 Open Pos.	0%	0%	0%	0%	0%	0%	0%
TO2 Ramp	HR1	HR1	HR1	CO₂	OFF	HR1	HR1
TO2 Signal Type	Pulse	On/Off	Pulse	On/Off	On/Off	On/Off	On/Off
TO2 Close Pos.	40%	40%	40%	40%	40%	70%	70%
TO2 Open Pos.	0%	0%	0%	0%	0%	35%	35%
TO3 Ramp	HR2	CR2	HR2	HR1	OFF	Fan ON	Fan Auto
TO3 Signal Type	On/Off	On/Off	On/Off	On/Off	On/Off	On/Off	On/Off
TO3 Close Pos.	40%	40%	40%	40%	40%	40%	40%
TO3 Open Pos.	0%	0%	0%	0%	0%	0%	0%
TO4 Ramp	HR2	HR2	HR2	HR1	OFF	HR1	HR1
TO4 Signal Type	Pulse	On/Off	Pulse	On/Off	On/Off	On/Off	On/Off
TO4 Close Pos.	40%	40%	40%	40%	40%	40%	40%
TO4 Open Pos.	0%	0%	0%	0%	0%	0%	0%
Motor Ramp	CR1	CO₂	CO₂	CO₂	CR1	CR1	CO₂
AO1 ramp	HR1	CR1	HR1	CR1	HR1	HR1	HR1
AO2 Ramp	HR2	HR1	HR2	HR1	OFF	HR2	Fan Auto
AI1 Input	OFF	SENS	SENS	SENS	OFF	OFF	SENS
AI2 Input	OFF	OFF	OFF	CO₂	OFF	OFF	OFF
DI1 Input	nSb.o	nSb.o	nSb.o	Occ.o	Occ.o	nSb.o	nSb.o
Heat Prop Band 2	2°C (4°F)	2°C (4°F)	2°C (4°F)	2°C (4°F)	2°C (4°F)	1°C (2°F)	1°C (2°F)
Heat Deadband 2	1.3°C (2.6°F)	1.3°C (2.6°F)	1.3°C (2.6°F)	1.3°C (2.6°F)	0.3°C (0.6°F)	1.3°C (2.6°F)	1.3°C (2.6°F)
Cool Deadband 2	1.3°C (2.6°F)	1.3°C (2.6°F)	1.3°C (2.6°F)	1.3°C (2.6°F)	0.3°C (0.6°F)	0.3°C (0.6°F)	0.3°C (0.6°F)

Legend

Grey Text = Standard default value

Bold Text = Special default value for selected application

HR	= Heating ramp
CR	= Cooling ramp
CO ₂	= Changeover ramp
SENS	= Changeover temperature sensor
Fan ON	= Fan powered box in continuous mode
Fan Auto	= Fan powered box in automatic mode (follows demand)
nSb.o	= Night Setback (normally open)
Occ.o	= Occupancy mode (normally open)
TO	= TRIAC output
AO	= Analog output
AI	= Analog input
DI	= Digital input

Notes



Recycling at end of life: please return this product to your Neptronic local distributor for recycling. If you need to find the nearest Neptronic authorized distributor, please consult www.neptronic.com.



neptronic®

400 Lebeau blvd, Montreal, Qc, H4N 1R6, Canada

www.neptronic.com

Toll free in North America: 1-800-361-2308

Tel.: (514) 333-1433

Fax: (514) 333-3163

Customer service fax: (514) 333-1091

Monday to Friday: 8:00am to 5:00pm (Eastern time)