

Models

EVCB14NITOS (0 TRIACS / pressure independent)
EVCB14NIT2S (2 TRIACS / pressure independent)
EVCB14NIT4S (4 TRIACS / pressure independent)
EVCB14NIT4X* (4 TRIACS / independent / external motor)
EVCB14NDT4X* (4 TRIACS / dependent / external motor)


EVCB14NDT4S (4 TRIACS / pressure dependent)
EVCB14NIT0SF (0 TRIACS / independent / feedback)
EVCB14NIT4SF (4 TRIACS / independent / feedback)

*For use with either floating or modulating actuators **TRL54** (*Thermostat 3x3*)

Description

The EVCB Series is a combination controller and thermostat with support for networked communications via the BACnet MS/TP or Modbus protocol. The Networkable VAV Controller is designed for simple and accurate control of any variable air volume box in a number of zone control configurations. Its field configurable algorithms enable versatile implementation of required control sequences.

Typical Application



Features

- Field configured VAV algorithms, inputs and outputs
- Built-in actuator, 70 lb-in. (select models, not available on EVCB14NIT4X and EVCB14NDT4X)
- Control external actuators using analog (0-10Vdc, adjustable) or floating signals with feedback (models EVCB14NIT4X and EVCB14NDT4X)
- On board differential pressure sensor (select models)
- · Simple air balancing and commissioning via thermostat
- Automatically sets operation mode to pressure dependent or independent based on the presence of air flow
- Select direction on analog outputs
- Configurable PI (Proportional-Integral) function
- Independent, configurable proportional control band and dead band per ramp
- Selectable internal or external temperature sensor (10KΩ)
- External CO2 sensor input with integrated logic
- Changeover by contact or external temperature sensor
- Internal and external temperature sensor calibration
- Optional potentiometer feedback for increased precision of actuator position
- Freeze protection
- Removable, raising clamp, non-strip terminals

Operational Features

- Backlit LCD with simple icon and text driven menus
- Select thermostat's default display
- Network service port via on-board mini USB connector
- Manual night set back or no occupancy override
- Multi level lockable access menu and setpoint
- Selectable Fahrenheit or Celsius scale
- 3-wire connection to controller and 4 push buttons

Networkable VAV Controller

Specification and Installation Instructions





EVCB Series / TRL54

Applications

- Single duct, cooling only
- Single duct cooling and/or heating
- Up to 4 stage reheat and/or cool
- Up to 4 On/Off heat and/or cool
- Up to 4 time proportioned (TPM) heat or reheat
- Up to 2 analog (0-10Vdc) reheat and/or cool
- Up to 2 floating heat and/or cool
- Pressure dependent or pressure independent
- With or without auto changeover
- Supply/exhaust (requires an additional EVC)

Network Communication

- BACnet MS/TP or Modbus communication port
- Select MAC address via DIP switch or via network
- Automatic baud rate detection

BACnet MS/TP®

- Automatic device instance configuration
- Copy & broadcast configuration via thermostat menu or via BACnet to other controllers
- BACnet scheduler
- Firmware upgradeable via BACnet
- Support for COV (change of value)

Modbus

- Modbus @ 9600, 19200, 38400 or 57600 bps
- RTU Slave, 8 bits (configurable parity and stop bits)
- Connects to any Modbus master

EVCB14N-TRL54-V505-191004-ESA Page | 1



Specification and Installation Instructions

Controller Specifications

| Description | EVCB Series | | | | | |
|--------------------------|--|--|--|--|--|--|
| Torque | 70 in.lb. [8 Nm] at rated voltage | | | | | |
| Power consumption | 10 VA max | | | | | |
| Running time through 90° | 90 seconds | | | | | |
| Power supply | 22 to 26 Vac 50/60 Hz | | | | | |
| Inputs | 2 Universal inputs (Thermistor 10KΩ Type 3, digital 24Vac/dry contact, or 0-10Vdc) | | | | | |
| inputs | 2 digital inputs | | | | | |
| | 2 analog outputs (0-10 Vdc or 2-10Vdc; selectable) | | | | | |
| Outputs | Up to 4 TRIAC outputs 24 Vac, 500mA max thermal fuse in series with each TRIAC output (on/off, pulse, or 2 floating outputs) | | | | | |
| Real Time Clock | Real-time clock (RTC) with super capacitor backup (approximately 3 days) | | | | | |
| BACnet | BACnet® MS/TP @ 9600, 19200, 38400 or 76800 bps (BAS-C) | | | | | |
| Modbus | Modbus RTU slave @ 9600, 19200, 38400 or 57600. Selectable parity and stop bit configuration: No parity, 2 stop bit Even parity, 1 stop bit Odd parity, 1 stop bit | | | | | |
| Communication connection | 24 AWG twisted-shield cable (Belden 9841 or equivalent). Maximum 50ft (15m) between controller and thermostat | | | | | |
| Electrical connection | 0.8 mm ² [18 AWG] minimum | | | | | |
| Operating temperature | 0°C to 50°C [32°F to 122°F] | | | | | |
| Storage temperature | -30°C to 50°C [-22°F to 122°F] | | | | | |
| Relative Humidity | 5 to 95% non condensing | | | | | |
| Weight | 1.26 kg. [2.8 lb] | | | | | |



The actuator performs an auto-stroke on power up. When changing the actuator adjustment screws, cycle power to initiate the auto-stroke. Auto-stroke is not available on EVC pressure independent without feedback.

Thermostat Specifications

| Description | TRL54 | | | | | |
|-----------------------|---|--|--|--|--|--|
| Sensor | Temperature | | | | | |
| Setpoint range | 10°C to 40°C [50°F to 104°F] | | | | | |
| Control accuracy | ±0.5°C [0.9°F] @ 22°C [71.6°F] typical calibrated | | | | | |
| Display resolution | ±0.1°C [0.2°F] | | | | | |
| Electrical connection | 3 wires to EVCB controller and 2 wires to BACnet/Modbus network 0.8 mm ² [18 AWG] minimum. Maximum 50ft (15m) between controller and thermostat | | | | | |
| Network service port | Mini USB connector | | | | | |
| Power supply | 24Vac or 24Vdc | | | | | |
| Power consumption | 1VA | | | | | |
| Operating temperature | 0°C to 50°C [32°F to 122°F] | | | | | |
| Storage temperature | -30°C to 50°C [-22°F to 122°F] | | | | | |
| Relative humidity | 5 to 95 % non condensing | | | | | |
| Enclosure protection | IP 30 (EN 60529) | | | | | |
| Weight | 0.1 kg. [0.22 lb] | | | | | |
| Dimensions | A = 3.00 in (78mm) B = 3.00 in (78mm) C = 1.00 in (24mm) D = 2.36 in (60mm) | | | | | |
| Note | The thermostat functions only with the EVCB Series controller. All the inputs/outputs are located on the EVCB Series except for the temperature sensor built-in the thermostat. | | | | | |




Specification and Installation Instructions

TRL54 Interface




| * | Cooling ON A: Automatic | * | Programming mode (Technician setting) | | Alarm status |
|------------|----------------------------|---------------------|---|---|--------------------|
| T & A | Heating ON A: Automatic | 6 | Menu set-up Lock |) | Energy saving mode |
| MIN MAX | Minimum/Maximum | °C _{or} °F | °C: Celsius scale °F: Fahrenheit scale | | |

Dimensions

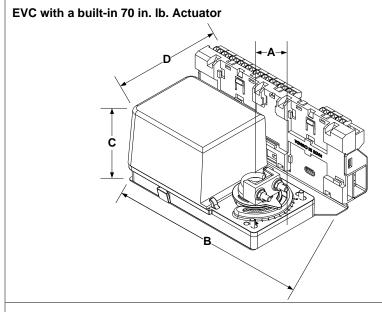

A = 1.50" | 39mm B = 7.25" | 185mm C = 3.25" | 83mm D = 5.50" | 140mm

EVC with a separate 180 in. lb. Actuator

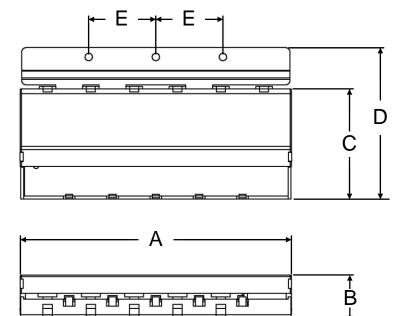

A = 7.20" | 183mm B = 1.23" | 31mm C = 2.93" | 74mm D = 4.02" | 102mm E = 1.78" | 45mm

www.neptronic.com



Specification and Installation Instructions

Mechanical Installation

- Manually close the damper blades and position the actuator to 0° or 90°.
- 2. Slide the actuator onto the shaft.
- 3. Tighten the nuts on the "U" bolt to the shaft with an 8mm wrench to a torque of 60 in-lb [6.7 Nm].
- Slide the mounting bracket under the actuator. Ensure free movement of the slot at the base of the actuator. Place the bracket pin at mid distance of the slot.
- 5. Affix the bracket to the ductwork with #8 self-tapping screws.




Do not press the clutch when the actuator is powered.


- Manually close the damper blades and position the actuator to 0° or 90°.
- 2. Slide the actuator onto the shaft.
- 3. Tighten the nuts on the "U" bolt to the shaft with an 8mm wrench to a torque of 150 in.lb. [17 Nm].
- Slide the mounting bracket under the actuator. Ensure free movement of the slot at the base of the actuator. Place the bracket pin at mid distance of the slot.
- 5. Affix the bracket to the ductwork with #8 self-tapping screws.
- Connect the cable from the EVC to the terminal in the actuator as shown.




Do not press the clutch when the actuator is powered.

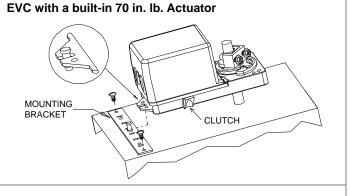

EVC with a separate 180 in. lb. Actuator

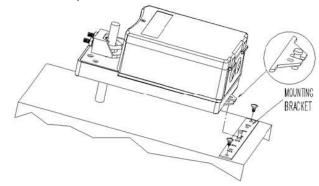


Terminals on the Actuator



Signal cable from EVC controller (models EVCB14NIT4X and EVCB14NDT4X)

Use to connect the external motor on EVCB14NIT4X and EVCB14NDT4X.

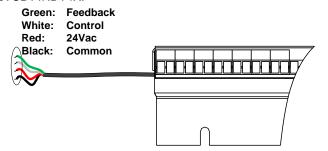




Specification and Installation Instructions

Mounting Instructions



CAUTION: Remove power to avoid a risk of malfunction.

- A. Remove the captive screw that's holding the base and the front cover of the unit together.
- B. Lift the front cover of the unit to separate it from the base.
- C. Pull all wires through the holes in the base.
- D. Secure the base to the wall using wall anchors and screws (supplied). Make the appropriate connections.
- E. Mount the control module on the base and secure using the screw.

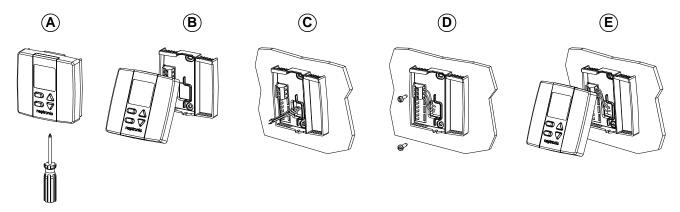

BACnet or Modbus Address DIP Switch (DS1)

MAC address for communication, are selectable by DIP switch using binary logic. If you do not change device instance in program mode, it will be automatically modified according to the MAC address.



Note: Avoid using addresses above 246 when selecting Modbus MAC address.

| MAC Address | DS.1 = 1 | DS.2 = 2 | DS.3 = 4 | DS.4 = 8 | DS.5 = 16 | DS.6 = 32 | DS.7 = 64 | DS.8 = 128 | Default Device Instance |
|-------------|----------|----------|----------|----------|-----------|-----------|-----------|------------|-------------------------|
| 0 | OFF | OFF | OFF | OFF | OFF | OFF | OFF | OFF | 153000 |
| 1 | ON | OFF | OFF | OFF | OFF | OFF | OFF | OFF | 153001 |
| 2 | OFF | ON | OFF | OFF | OFF | OFF | OFF | OFF | 153002 |
| 3 | ON | ON | OFF | OFF | OFF | OFF | OFF | OFF | 153003 |
| 4 | OFF | OFF | ON | OFF | OFF | OFF | OFF | OFF | 153004 |
| | | | | | | | | | |
| 126 | OFF | ON | ON | ON | ON | ON | ON | OFF | 153126 |
| 127 | ON | ON | ON | ON | ON | ON | ON | OFF | 153127 |


^{*} Slave addresses available by setting DS.8 to ON



Specification and Installation Instructions

Wiring


We strongly recommend that all Neptronic products be wired to a separate grounded transformer and that transformer shall service only Neptronic products. This precaution will prevent interference with, and/or possible damage to incompatible equipment.

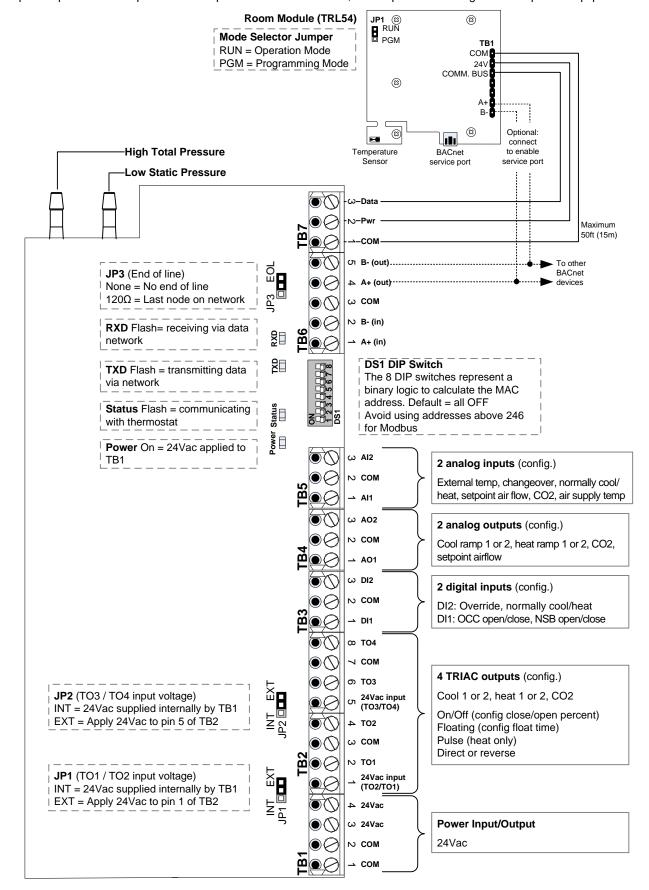

Specification and Installation Instructions

Pressure & Applications – Menu Overview (1 of 6)


For a description of the default settings for each application refer to Annex A: Control Apps on page 16.

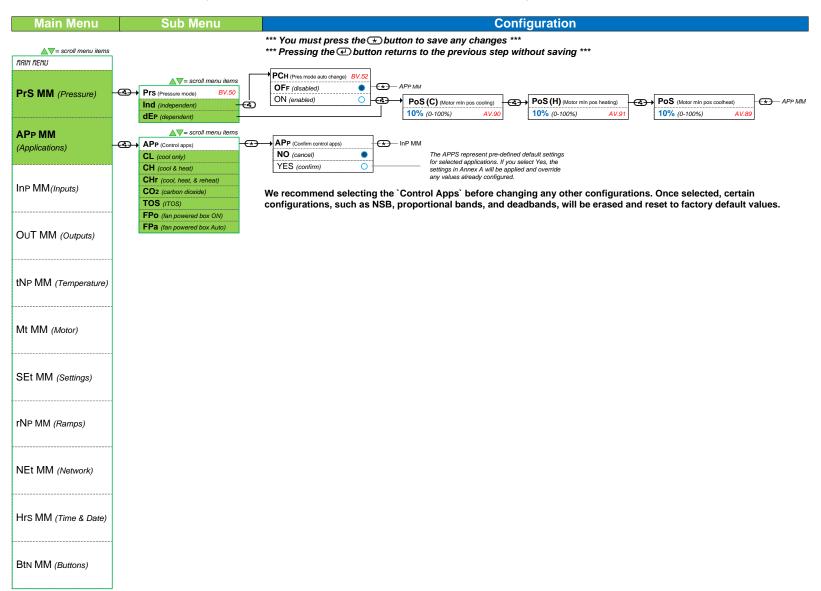



Specification and Installation Instructions


Inputs - Menu Overview (2 of 6)

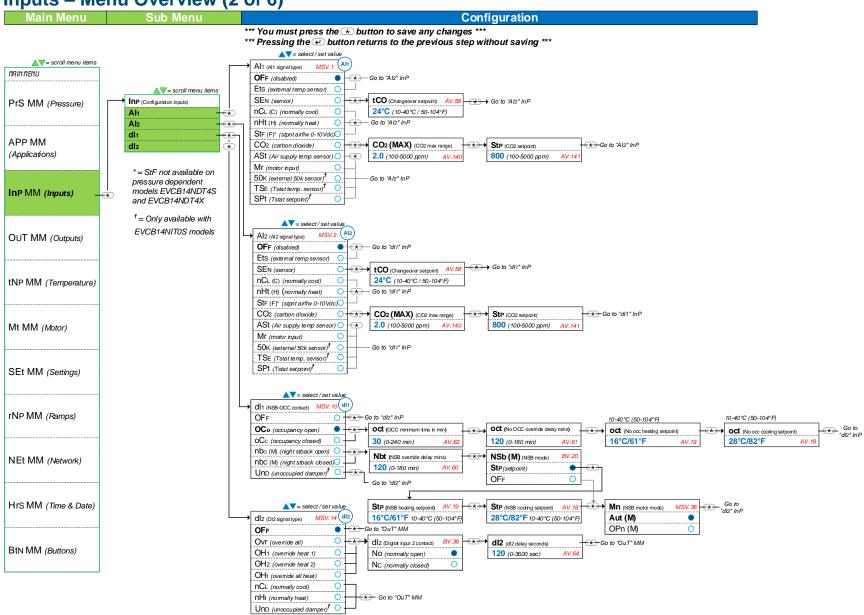



Specification and Installation Instructions


TRIAC Outputs - Menu Overview (3 of 6)

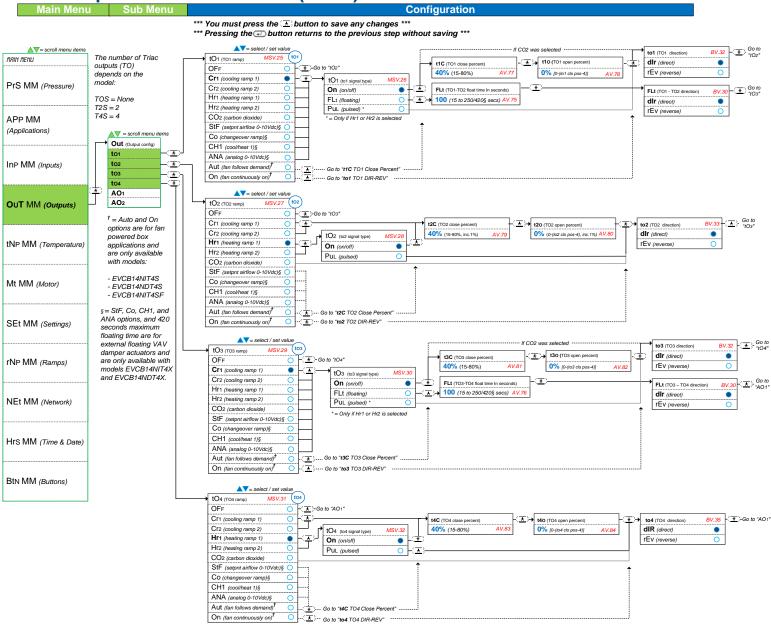



Specification and Installation Instructions


Analog Outputs - Menu Overview (4 of 6)

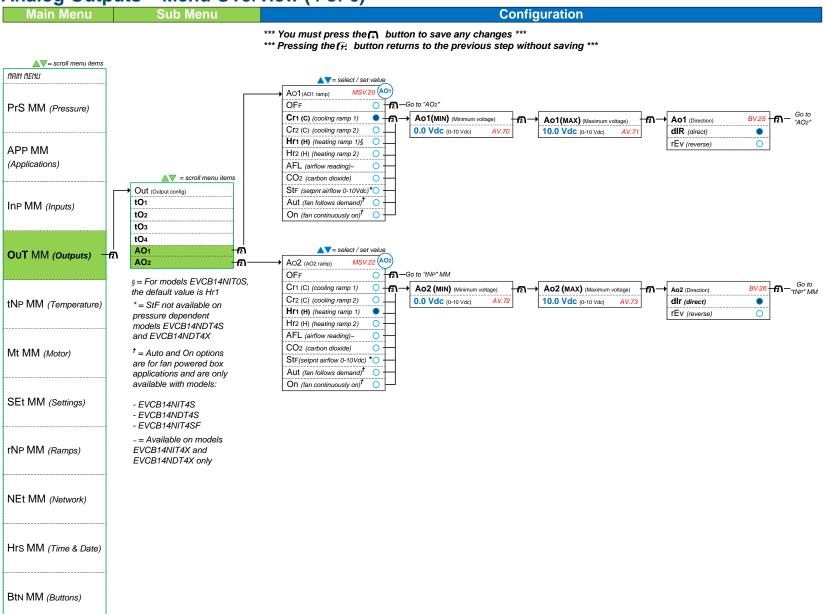



Specification and Installation Instructions

Settings – Menu Overview (5 of 6)

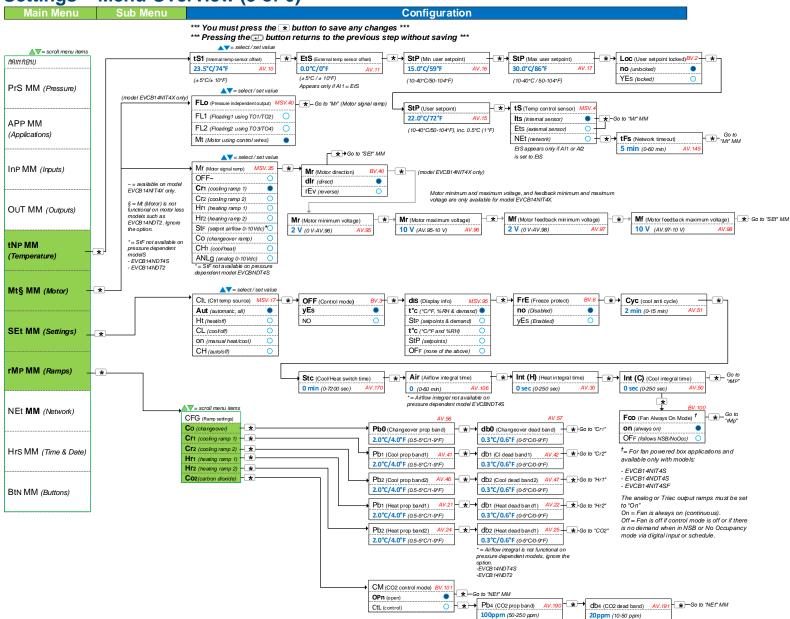



Specification and Installation Instructions

Settings – Menu Overview (6 of 6)

Sub Menu Main Menu Configuration *** You must press the ** button to save any changes *** *** Pressing the button returns to the previous step without saving *** ▲▼= scroll menu items PrS MM (Pressure) APP MM (Applications) ▲▼= select / set value nEt (Network choice) bAc (BACnet) Go to "Abr" (BACnet auto baud rate) Md (Modbus) 0 Go to "Abr" (Modbus auto baud rate) InP MM (Inputs) ▲▼= select / set value Go to "HrS" bAu (Modbus baud rate) CFG (Modbus comport config) MA (Modbus address) € Abr (Modbus auto baud rate) ▲▼= scroll menu items 57.6k (9.6k, 19.2k, 38.4, 57.6k) nP2 (no parity, 2 stop bits) 1 (1-246) No (Manual) OUT MM (Outputs) nEt (Network config) Yes (Automatic) Modifiable only if Auto Baud Rate EP1 (even parity, 1 stop bit) Modifiable only if all DS2 DIP • set to "No". switches are set to OFF. tYP (Type) OP1 (odd parity, 1 stop bit) Md (Modbus) ▲▼= select / set value Go to Add (MSTP MAC address) 1000 bAC (BACnet) M (MSTP MAX master) Abr (BACnet auto baud rate) bAu (Bacnet baud rate) tNP MM (Temperature) **→** CPY (copy configuration) No (Manual) 76.8k (9.6k, 19.2k, 38.4, 76.8k) 0 (0-254) 127 (1-127) Modifiable only if Auto Baud Rate Modifiable only if all DS2 DIP Yes (Automatic) • If type = bAC, menu contains switches are set to OFF. "tYpe", "bAC" and "CPY" Go to "Hrs" MM ▲▼= select / set value If type = Md, menu contains "tYpe Copy Config Cpy (Confirm copy config) BV.90 **₩** Mt MM (Motor) Add (End address) Add (Start address) 0 (0-254: max=start + 63) AV. 166 nO Copy (cancel) +in (in progress) 0 (0-254, inc.1) AV.16 YES Copy (confirm) 0 100 Go to SCd (Config succeed) SEt MM (Settings) AV.167 (done) Refer to Copy Config Annnex for a complete list of messages and error codes. rNP MM (Ramps) ▲▼= select / set value Hrs (Hours) tF (Set time display format) MI (Minutes) Vr (Year) Local Date 12 (1-24 or 1-12 am/pm) 00 (00-59) 24 (24-hour format) 15 (15-99) NEt MM (Network) 12 (AM/PM format) 0 Local Date ★ dAy Local Date Mo (Month) -Go to "BtN" 1 (1-12) 1 (1-31) Hrs MM (*) (Time & Date) ▲▼= select / set value -Go to "PrS" BLK (Bottom left key locked) ULK (Upper left key locked) AK (Arrows key locked) NO NO NO Btn MM (Buttons) YES YES YES 0 0



Specification and Installation Instructions

Operation Menus

This menu is accessible through normal operation mode. The Mode Selector jumper (JP1) of the thermostat must be set to the "RUN" position (Operation Mode). Refer to Wiring on page 6.

7. Press the [*] and [↵] buttons simultaneously for 5 seconds. The "ENTER PRSS₩ORD" screen appears.

[50 to 104°F]

- 8. Enter the password within 1 minute by using the arrow keys to increase or decrease the value and the [*] and [4] buttons to toggle between the digits.
 - a. Password 372 = Temperature Offset Menu
 - b. Password 637 = Network Settings Menu
 - c. Password **757** = Airflow Balance Mode
- 9. If you enter the wrong password, the thermostat displays "Eror" and returns to Operation Mode. The thermostat will return to normal mode if you navigate through the entire menu and do not make any selection, or if you do not press any key for 5 minutes. The changed values will be saved automatically.

Menu 372 – Temperature Offset

1. "T51" (temperature sensor offset)

Range: 10 to 40°C

Offset: Max ± 5°C

Increment: 0.1°C [0.2°F]

Compare the displayed temperature reading with a known value from a thermometer. To offset or calibrate the sensor, use the arrows key to set the desired temperature reading. This is useful for thermostats installed in areas where the temperature read is slightly different than the room's actual temperature. For example, a thermostat placed right under the air diffuser. If the thermostat is set to use an external temperature sensor (**EtS**), the thermostat displays "OFF".

2. "ET5" (external temperature sensor offset)

Range: 0 to 50°C

50°C [41 to 122°F]

Offset: Max ± 5°C

Increment: 0.1°C [0.2°F]

This option appears if you've set one of the analog inputs to **EtS** (External temperature sensor). When the thermostat is connected to the appropriate analog input, the display shows the temperature read by the external temperature sensor. Adjust the offset by comparing it with a known value (e.g. thermometer). If the sensor is not connected or short circuited, then the unit displays the sensor's limit.

3. "PR5" (input 3 reading)



Range: 250mV (0") to 4000mV (1")

Displays the voltage output value in mV of the pressure sensor. Does not appear for EVCB14NDT4S and EVCB14NDT4X (pressure dependant) models.

4. "PR5 MIN" (input 3 minimum reading)




Range: 10mV to 180mV

Default: 60mV

This setting represents the deadband of the pressure sensor in mV. For advanced users or special applications only. We recommend that you use the default setting of 60mV. Does not appear for EVCB14NDT4S and EVCB14NDT4X (pressure dependant) models.

Menu 637 – Network Settings

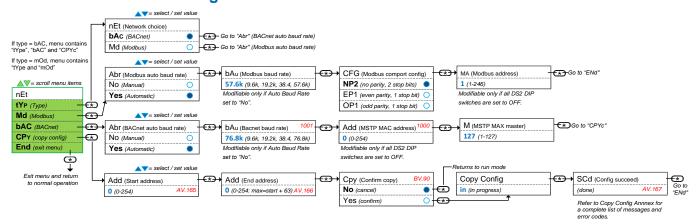




Specification and Installation Instructions

Menu 757 - Airflow Balance Mode

Pressure Independent: models EVCB14NIT0S, EVCB14NIT2S, EVCB14NIT4X and EVCB14NIT4S

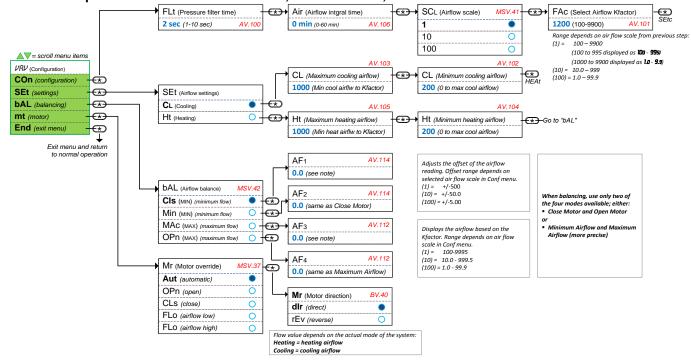


^{***} You must press the ** button to save any changes ***

^{***} Pressing the button returns to the previous step without saving ***



Note: Refer to EVCB-Airflow Balance Instructions on Neptronic website for further information on the airflow balancing function.

Pressure Dependent: models EVCB14NDT4S, EVCB14NDT4X or other models if in pressure dependent mode



Reset to Factory Default Settings



This will erase all actual configurations and replace them with the factory default settings.

- 2. The "PR5" screen appears. Enter **372** within 1 minute by using the arrow keys to increase or decrease the value and the and buttons to toggle between the digits.
- 3. Use the arrow buttons to select YES and then press 🖈.

Operation Mode

The Mode Selector Jumper (JP1) of the thermostat must be set to the "RUN" position (Operation Mode). Refer to Wiring on page 5.

Power Up

Upon power up, the LCD illuminates and all segments appear for 2 seconds. The thermostat then displays its current version of the thermostat for 2 seconds followed by the current version of the controller for 2 seconds. Pressing any key on the thermostat illuminates the LCD for 4 seconds.



Specification and Installation Instructions

Temperature

The thermostat displays the temperature reading for 8 seconds. If the sensor is disconnected or short circuited, then the unit displays the sensor's limits. To toggle the temperature scale between °C and °F, press the button.

Temperature Setpoint

To display the setpoint, press the \triangle or ∇ key twice. The set point appears for 5 seconds. To adjust the setpoint, press the arrow keys while the temperature is displayed. If the setpoint adjustment has been locked, the lock θ symbol appears.

Air Flow and Air Supply Temperature*

Press and hold the button for 5 seconds and use the arrow keys to view the:

"FLO" (airflow)

"F05" (airflow setpoint)

"DPR" (actual damper position percent)

"R5T (air supply temperature).

After 5 seconds without any action, the thermostat returns to operation mode. The air supply temperature appears only if analog input Al1 or Al2 are configured with the AST option. The airflow and airflow setpoint only appear when in pressure independent mode. The actual damper position percent only appear with the following standard models: EVCB14NIT0S, EVCB14NIT2S, EVCB14NIT4S, EVCB14NIT4S, EVCB14NIT4SF

Control Mode

To access the Control Mode, press the button. The Control Mode appears for 5 seconds. Press the button to scroll through the following control modes. These options can vary depending on the options selected in "Temp Control Mode" and "Enable OnOff Control Mode".

- Auto (Automatic Cooling or Heating)
- Cooling only (on, with cooling symbol)
- · Heating only (on, with heating symbol)
- OFF (if it is not disabled in Programming Mode)

Night Set Back (NSB) or Occupancy Mode

This function is only available if you set DI1 to **nSb** (Night set back contact) or **Occ** (occupancy mode). If the DI1 contact is triggered, the thermostat enters NSB or No Occupancy Mode (the) symbol appears) and uses the NSB or OCC heating and cooling setpoints.

If not locked, you can override the night set back or no occupancy mode for a predetermined period by pressing any of the 4 buttons. During the override period the ⁾ symbol will flash. If the ⁾ symbol does not flash, the override period is finished or the night set back or no occupancy override has been locked in programming mode.

Set Time and Date

- 1. Ensure that JP1 on the thermostat is set to run.
- 2. Press and hold the button for 5 seconds
- 3. Use the arrow keys to set the desired value. Press the button to save and got to the next step. Press the button to go to the previous step without saving.

▲▼= select / set value ←×→ HOURS MINITES YERR SET TIME DISPLAY FORMAT 12 (1-24 or 1-12 am/pm) 24 (24-hour format) 00 (00-59) **15** (15-99) 12 (AM/PM format) MONTH DRY Go to "PrSs" 1 (1-12) Local Date Local Date



Specification and Installation Instructions

Annex A: Control Apps

Refer to Pressure & Applications – Menu Overview (1 of 6) on page 7 for more information. The available **Control Apps** vary according to the model.

| Description | CL (cool only) | CLHt (cool/heat) | CHrH (cool/heat/reheat) | CO2 (CO2) | ITOS (ITOS) | FPbo (fan powered ON) | FPbA (fan powered Auto) |
|-------------------|-------------------|---------------------|-------------------------|---------------|----------------|---------------------------------|--------------------------------|
| Min. Setpoint | 20°C (68°F) | 20°C (68°F) | 20°C (68°F) | 20°C (68°F) | 15°C (59°F) | 15°C (59°F) | 15°C (59°F) |
| Max. Setpoint | 28°C (82°F) | 28°C (82°F) | 28°C (82°F) | 28°C (82°F) | 30°C (86°F) | 30°C (86°F) | 30°C (86°F) |
| Changeover Setpnt | 24°C (75°F) | 20°C (68°F) | 20°C (68°F) | 20°C (68°F) | 24°C (75°F) | 24°C (75°F) | 24°C (75°F) |
| TO1 Ramp | HR1 | CR1 | HR1 | CR1 | OFF | HR1 | HR1 |
| TO1 Signal Type | On/Off | On/Off | On/Off | On/Off | On/Off | On/Off | On/Off |
| TO1 Close Pos. | 40% | 40% | 40% | 40% | 40% | 35% | 35% |
| TO1 Open Pos. | 0% | 0% | 0% | 0% | 0% | 0% | 0% |
| TO2 Ramp | HR1 | HR1 | HR1 | CO2 | OFF | HR1 | HR1 |
| TO2 Signal Type | Pulse | On/Off | Pulse | On/Off | On/Off | On/Off | On/Off |
| TO2 Close Pos. | 40% | 40% | 40% | 40% | 40% | 70% | 70% |
| TO2 Open Pos. | 0% | 0% | 0% | 0% | 0% | 35% | 35% |
| TO3 Ramp | HR2 | CR2 | HR2 | HR1 | OFF | Fan ON | Fan Auto |
| TO3 Signal Type | On/Off | On/Off | On/Off | On/Off | On/Off | On/Off | On/Off |
| TO3 Close Pos. | 40% | 40% | 40% | 40% | 40% | 40% | 40% |
| TO3 Open Pos. | 0% | 0% | 0% | 0% | 0% | 0% | 0% |
| TO4 Ramp | HR2 | HR2 | HR2 | HR1 | OFF | HR1 | HR1 |
| TO4 Signal Type | Pulse | On/Off | Pulse | On/Off | On/Off | On/Off | On/Off |
| TO4 Close Pos. | 40% | 40% | 40% | 40% | 40% | 40% | 40% |
| TO4 Open Pos. | 0% | 0% | 0% | 0% | 0% | 0% | 0% |
| Motor Ramp | CR1 | COr | COr | COr | CR1 | CR1 | COr |
| AO1 ramp | HR1 | CR1 | HR1 | CR1 | HR1 | HR1 | HR1 |
| AO2 Ramp | HR2 | HR1 | HR2 | HR1 | OFF | HR2 | Fan Auto |
| Al1 Input | OFF | SENS | SENS | SENS | OFF | OFF | SENS |
| Al2 Input | OFF | OFF | OFF | CO2 | OFF | OFF | OFF |
| DI1 Input | nSb.o | nSb.o | nSb.o | Occ.o | Occ.o | nSb.o | nSb.o |
| Heat Prop Band 2 | 2°C (4°F) | 2°C (4°F) | 2°C (4°F) | 2°C (4°F) | 2°C (4°F) | 1°C (2°F) | 1°C (2°F) |
| Heat Deadband 2 | 1.3°C (2.6°F) | 1.3°C (2.6°F) | 1.3°C (2.6°F) | 1.3°C (2.6°F) | 0.3°C (0.6°F) | 1.3°C (2.6°F) | 1.3°C (2.6°F) |
| Cool Deadband 2 | 1.3°C (2.6°F) | 1.3°C (2.6°F) | 1.3°C (2.6°F) | 1.3°C (2.6°F) | 0.3°C (0.6°F) | 0.3°C (0.6°F) | 0.3°C (0.6°F) |

Legend

Grey Text = Standard default value

Bold Text = Special default value for selected application

HR = Heating ramp
CR = Cooling ramp
COr = Changeover ramp


SENS = Changeover temperature sensor Fan ON = Fan powered box in continuous mode


Fan Auto = Fan powered box in automatic mode (follows demand)

nSb.o = Night Set Back (normally open)
Occ.o = Occupancy mode (normally open)

TO = TRIAC output AO = Analog output AI = Analog input DI = Digital input

| Notes | |
|-------|--|
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| _ | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |

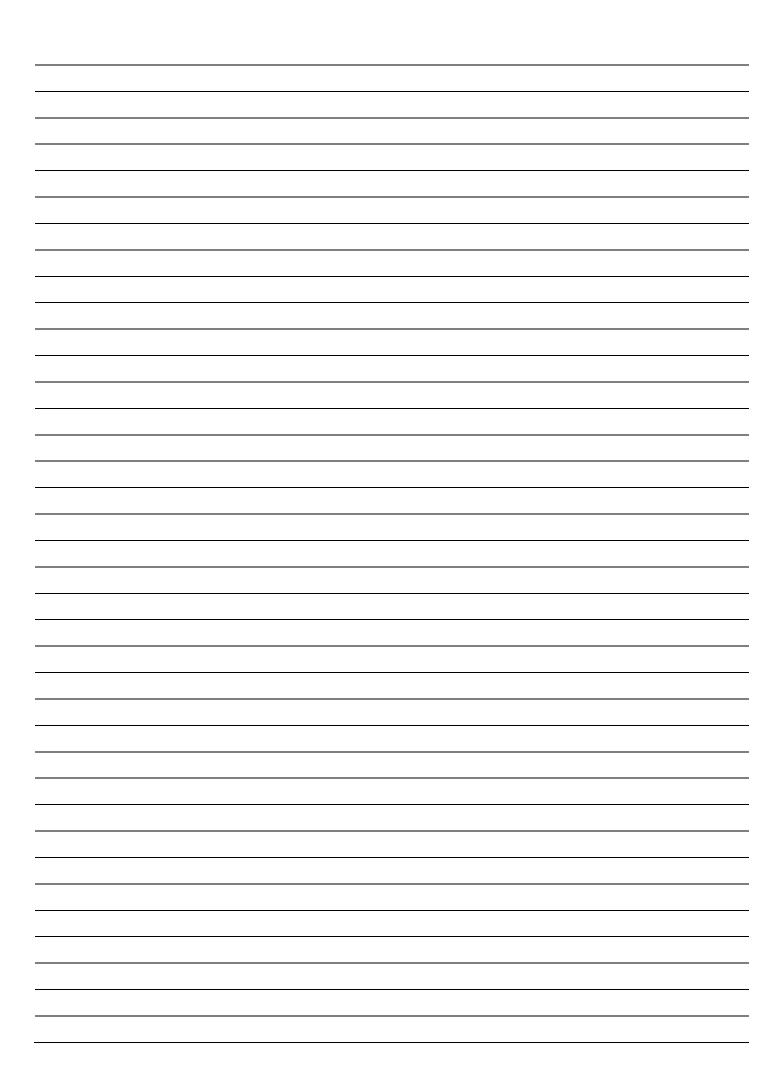

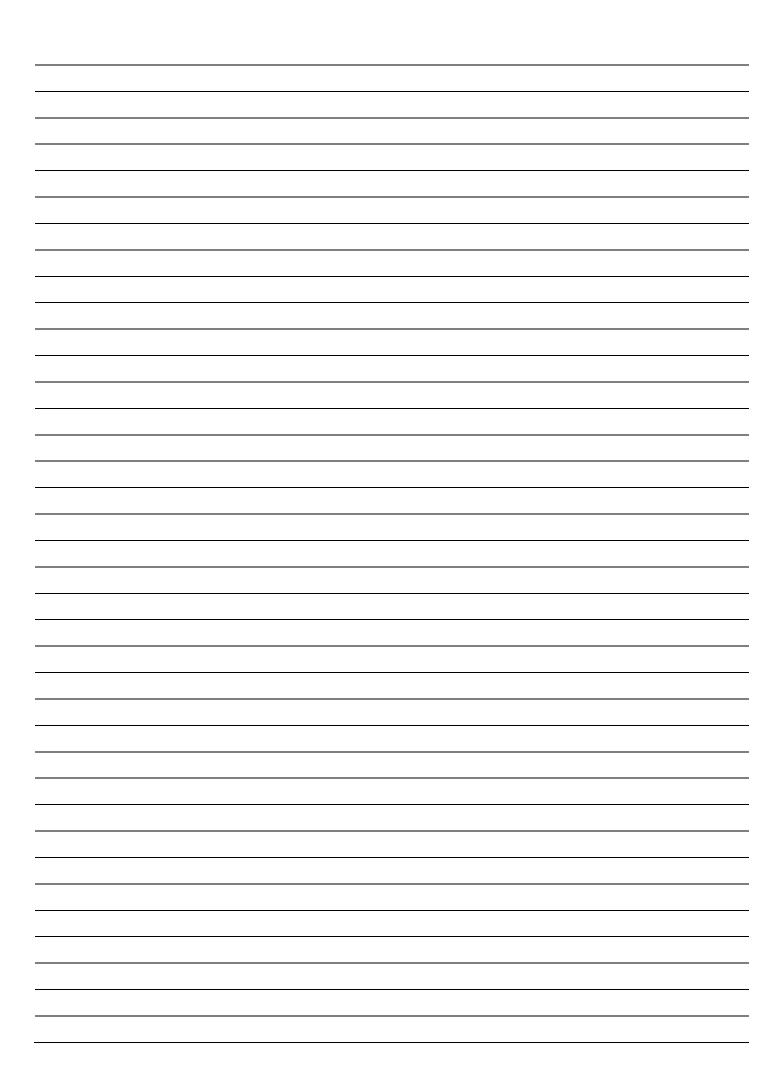



Recycling at end of life: please return this product to your Neptronic local distributor for recycling. If you need to find the nearest Neptronic authorized distributor, please consult **www.neptronic.com**.



neptronic

400 Lebeau blvd, Montreal, Qc, H4N 1R6, Canada

www.neptronic.com